

UL 827

ISBN 0-7629-0067-9

Central-Station Alarm Services

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM  **Documents**
Document Sharing Hub

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

Underwriters Laboratories Inc. (UL)
333 Pfingsten Road
Northbrook, IL 60062-2096

UL Standard for Safety for Central-Station Alarm Services, UL 827

Sixth Edition, Dated October 1, 1996

Revisions: This Standard contains revisions through and including January 12, 2007.

Summary of Topics

These revisions are being issued to add performance requirements for satellite stations that are manually operated, to add requirements for multiple call verification and to delete the certification requirements in 1.12.

UL Standards for Safety are developed and maintained in the Standard Generalized Markup Language (SGML). SGML -- an international standard (ISO 8879-1986) -- is a descriptive markup language that describes a document's structure and purpose, rather than its physical appearance on a page. Due to formatting differences resulting from the use of UL's new electronic publishing system, please note that additional pages (on which no requirements have been changed) may be included in revision pages due to relocation of existing text and reformatting of the Standard.

Text that has been changed in any manner is marked with a vertical line in the margin. Changes in requirements are marked with a vertical line in the margin and are followed by an effective date note indicating the date of publication or the date on which the changed requirement becomes effective.

The following table lists the future effective dates with the corresponding item.

Future Effective Date	References
December 31, 2008	Paragraphs 11.6, 11.9, 11.10, 11.12 and 11.13

The revised requirements are substantially in accordance with UL's Proposal(s) on this subject dated November 4, 2005 and July 26, 2006.

The revisions dated January 12, 2007 include a reprinted title page (page1) for this Standard.

The UL Foreword is no longer located within the UL Standard. For information concerning the use and application of the requirements contained in this Standard, the current version of the UL Foreword is located on ULStandardsInfoNet at: <http://ulstandardsinfolnet.ul.com/ulforeword.html>.

The master for this Standard at UL's Northbrook Office is the official document insofar as it relates to a UL service and the compliance of a product with respect to the requirements for that product and service, or if there are questions regarding the accuracy of this Standard.

UL's Standards for Safety are copyrighted by UL. Neither a printed copy of a Standard, nor the distribution diskette for a Standard-on-Diskette and the file for the Standard on the distribution diskette should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

Revisions of UL Standards for Safety are issued from time to time. A UL Standard for Safety is current only if it incorporates the most recently adopted revisions.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

UL will attempt to answer support requests concerning electronic versions of its Standards. However, this support service is offered on a reasonable efforts basis only, and UL may not be able to resolve every support request. UL supports the electronic versions of its Standards only if they are used under the conditions and operating systems for which it is intended. UL's support policies may change from time-to-time without notification.

UL reserves the right to change the format, presentation, file types and formats, delivery methods and formats, and the like of both its printed and electronic Standards without prior notice.

Purchasers of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgement (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

If a single-user version electronic Standard was purchased, one copy of this Standard may be stored on the hard disk of a single personal computer, or on a single LAN file-server or the permanent storage device of a multiple-user computer in such a manner that this Standard may only be accessed by one user at a time and for which there is no possibility of multiple concurrent access.

If a multiple-user version electronic Standard was purchased, one copy of the Standard may be stored on a single LAN file-server, or on the permanent storage device of a multiple-user computer, or on an Intranet server. The number of concurrent users shall not exceed the number of users authorized.

Electronic Standards are intended for on-line use, such as for viewing the requirements of a Standard, conducting a word search, and the like. Only one copy of the Standard may be printed from each single-user version of an electronic Standard. Only one copy of the Standard may be printed for each authorized user of a multiple-user version of an electronic Standard. Because of differences in the computer/software/printer setup used by UL and those of electronic Standards purchasers, the printed copy obtained by a purchaser may not look exactly like the on-line screen view or the printed Standard.

An employee of an organization purchasing a UL Standard can make a copy of the page or pages being viewed for their own fair and/or practical internal use.

The requirements in this Standard are now in effect, except for those paragraphs, sections, tables, figures, and/or other elements of the Standard having future effective dates as indicated in the note following the affected item. The prior text for requirements that have been revised and that have a future effective date are located after the Standard, and are preceded by a "SUPERSEDED REQUIREMENTS" notice.

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

New product submittals made prior to a specified future effective date will be judged under all of the requirements in this Standard including those requirements with a specified future effective date, unless the applicant specifically requests that the product be judged under the current requirements. However, if the applicant elects this option, it should be noted that compliance with all the requirements in this Standard will be required as a condition of continued Listing and Follow-Up Services after the effective date, and understanding of this should be signified in writing.

Copyright © 2007 Underwriters Laboratories Inc.

This Standard consists of pages dated as shown in the following checklist:

Page	Date
1-4	January 12, 2007
5	October 1, 1996
6-8B	January 12, 2007
9-11	October 1, 1996
12	April 23, 1999
12A-13	October 1, 1997
14	October 1, 1996
15	April 23, 1999
16-20	October 1, 1996
21	April 23, 1999
22	October 1, 1996
23	April 23, 1999
24-26	October 1, 1996
27-30B	January 12, 2007
31-50	October 1, 1996
51	April 23, 1999
52-52A	January 12, 2007
52B	April 23, 1999
53-55	October 1, 1996
56-58B	January 12, 2007
59-66	October 1, 1996
A1-A2	April 23, 1999
B1-B2	October 1, 1997
B3-B4	January 12, 2007
SR1-SR2	January 12, 2007

Document Was Downloaded By Rice, Shi SHIMISHENG
 For Use By KUANTECH CO LTD
 12039 : 8/1/2007 - 8:55 PM
 UL COPYRIGHTED MATERIAL –

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
 DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

No Text on This Page

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

OCTOBER 1, 1996

(Title Page Reprinted: January 12, 2007)

1

UL 827

Standard for Central-Station Alarm Services

First Edition – September, 1971

Second Edition – October, 1972

Third Edition – October, 1977

Fourth Edition – January, 1982

Fifth Edition – August, 1993

Sixth Edition

October 1, 1996

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

Revisions of this Standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest set of revised requirements. Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <http://csds.ul.com>.

ISBN 0-7629-0067-9

COPYRIGHT © 1977, 2007 UNDERWRITERS LABORATORIES INC.

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM
UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM
 **Documents**
Document Sharing Hub

No Text on This Page

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

CONTENTS

INTRODUCTION

1 Scope	5
2 General	6
2.1 Components	6
2.2 Units of measurement	7
2.3 Undated references	7
3 Glossary	7
3.1 General	7
3.2 Definitions common to burglar- and fire-alarm systems	7
3.3 Definitions common to burglar-alarm	10
3.4 Definitions common to fire-alarm	11
3.5 Definitions common to residential monitoring stations	11

FACILITIES AND EQUIPMENT

4 Building Construction Requirements	12
5 Physical Protection	14
6 Fire Protection	15
6.1 Portable fire extinguishers	15
6.2 Fire suppression system	16
6.3 Water sheds	16
6.4 Repeater station fire protection	16
6.5 Automatic fire-alarm system	16
7 Standby Lighting	16
8 Clocks	17
9 Power Supply	17
9.1 General	17
9.2 Installation	18
9.3 Source	18
9.4 Primary power supply	18
9.5 Secondary power supply	18
9.6 Continuity of power supply	19
9.7 Storage batteries	19
9.8 Overcurrent protection for external batteries	20
9.9 Charging method	20
9.10 Trickle- or float-charged batteries	20
9.11 Battery chargers and DC power supplies	21
9.12 Stationary, engine-driven generators	21
9.13 Security	22
9.14 Uninterruptible power supply (UPS) units	23
9.15 Uninterruptible battery supply (UBS) units	24
10 Cable System	24
10.1 General	24
10.2 Underground entrance	25
10.3 Overhead entrance	25
10.4 Conductors inside the building	25
10.5 Antenna cable	26
11 Subsidiary Stations	27
12 Equipment	29

UL COPYRIGHTED MATERIAL -

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub

13 Receiver Units	30
13.1 Direct-wire burglar-alarm systems	30
13.2 Code (McCulloh) transmitter systems	30
13.3 Multiplex systems	31
13.4 Digital alarm radio system (DARS)	32
13.5 One way radio alarm system (OWRAS)	33
13.6 Two-way radio alarm system (TWRAS)	35
13.7 Digital alarm communicator system units	35
14 Automation Systems	37

FIRE-ALARM SERVICES

15 Type of Service	39
16 Central-Station Operation	39
17 Personnel (Operators and Runners)	40
18 Runner's Equipment	40
19 Communication and Test	41
20 Re-Transmission	41
21 Records	41
22 Maintenance and Service	43
22.1 Contracts and agreements	43
22.2 Alarm, supervisory, and trouble signals	43
22.3 Signals from systems other than central-station fire-alarm systems	43
23 Testing and Inspection	44
24 Protected Premises Control and Transmitter Units	44

BURGLAR-ALARM SERVICES

25 Central-Station Operation	44
26 Personnel (Operators and Runners)	45
27 Runner's Equipment	45
28 Communication and Test	45
29 Re-Transmission	45
30 Burglar-Alarm Protected Premises Control Units	46
30.1 General	46
30.2 Direct-wire, burglar-alarm subscriber control units	46
30.3 Code (McCulloh) transmitter burglar-alarm systems subscriber control units	46
30.4 Multiplex burglar-alarm systems subscriber control unit	47
30.5 Digital alarm communicator transmitter (DACT) subscriber control unit	47
30.6 Radio (RF) systems subscriber's control unit	47
31 Burglar-Alarm Protection Service	47
31.1 Alarm response time	47
31.2 Signal transmission methods for burglar-alarm systems	49
31.3 Line security	51
32 Openings and Closing	51
32.1 General	51
32.2 Openings and closing without a schedule	52
32.3 Openings and closing with a schedule	52A
32.4 Unscheduled	53
32.5 Control unit programming	53
33 Closing and Malfunctions During Closing	54
34 Alarms and Unauthorized Openings	54
34.1 Alarm investigation	54

34.2 Alarm verification	56
34.3 Investigation of a compromise attempt	58
34.4 Investigation of a missing check-in signal	58
34.5 Multiplex communication channel disruption	58A
34.6 Alarm response overruns	58A
34.7 Unwanted alarms	59
34.8 Signals from systems other than central-station burglar-alarm systems	59
35 Identification of Subscribers	59
36 Handling of Subscriber's Keys	60
36.1 General	60
36.2 Key vaults	60
37 Records	60
38 Maintenance and Service	62
38.1 Contracts and agreements	62
38.2 Repairs	62
39 Power Failure	63

RESIDENTIAL MONITORING STATION

40 Residential Monitoring Station Operation	63
41 Personnel (Operators)	64
42 Signal Processing	64
43 Re-Transmission	64
44 Records	65

APPENDIX A

Standards for Components.....	A1
-------------------------------	----

APPENDIX B

PROCEDURES FOR ISSUING AND CANCELING CENTRAL-STATION ALARM CERTIFICATES

B1 Certificates	B1
B2 Forms and Instructions	B1
B3 Procedure For Issuing A Central-Station Alarm-System Certificate	B2
B4 Faster Service By Fax	B2
B5 Correction of Defects	B3
B6 Master Certificate File	B3
B7 Maintenance and Service	B3
B8 Service Area	B4

UL COPYRIGHTED MATERIAL -

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

This page intentionally left blank.

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

INTRODUCTION

1 Scope

1.1 These requirements apply to:

- a) Central-stations providing watchman, fire-alarm, and supervisory services as described in the National Fire Alarm Code, NFPA 72;
- b) Central-station burglar-alarm systems intended and specifically designated for burglary protection use at mercantile and banking premises, on mercantile safes and vaults, and on bank safes and vaults; and
- c) Residential monitoring stations monitoring residential alarm systems.

1.2 These requirements apply to central-stations, subsidiary stations and residential monitoring stations that are intended to be located in buildings constructed in accordance with building codes, such as the Building Officials and Code Administrators (BOCA) National Building Code, the Standard Building Code, and the Uniform Building Code.

1.3 The central-station burglar- and fire-alarm station and residential alarm systems covered by these requirements are systems in which the operation of electrical protection circuits and devices are signaled automatically to, recorded in, maintained in, and supervised from a central-station or residential monitoring station having trained operators and runners on duty at all times.

1.4 Requirements covering the construction and operation of burglar-alarm units used in the burglar-alarm systems covered by this Standard are contained in the Standards for Central-Station Burglar-Alarm Units, UL 1610, and Digital Alarm Communicator System Units, UL 1635.

1.5 Burglar-alarm protective devices installed on individual properties are classified as to the extent of protection at each location. Requirements covering installation and classification (of extent) of alarm protective equipment at individual locations are contained in the Standard for Installation and Classification of Burglar and Holdup Alarm Systems, UL 681.

1.6 Requirements covering the construction and operation of fire-protective signaling equipment used in the systems covered by this standard are contained in the Standard for Control Units for Fire-Protective Signaling Systems, UL 864.

1.7 Systems covered by these requirements operate within the limits of the National Electrical Code, ANSI/NFPA 70, as applied by the local authority having jurisdiction. The Articles of the National Electrical Code that apply are:

- a) Article 725, within the limits of Class 2 or Class 3 remote-control and signaling circuits for burglar-alarm systems;
- b) Article 760 for fire-alarm systems;
- c) Article 800 for outside wiring and protectors; and
- d) Article 820 for protectors for radio antennas.

1.8 Requirements for software and hardware, and the installation and operation of an automation system in a central-station, subsidiary station or residential monitoring station are covered by the Standard for Central-Station Automation Systems, UL 1981, or by the Standard for Control Units for Fire-Protective Signaling Systems, UL 864, and/or Central-Station Burglar-Alarm Units, UL 1610.

1.9 Relocated as 1.12 October 1, 1997

1.10 A reference made to "station" refers to a central-station (burglary or fire), subsidiary station or residential monitoring station, depending upon the context in which it is used.

1.11 These requirements do not cover the communication channel between the protected property and the station. This includes:

- a) The company that provides the communication channel and
- b) The equipment that is used to provide the communication channel.

Exception No. 1: If the communication channel is owned and operated by the station, these requirements do apply.

Exception No. 2: These requirements do apply to an alarm and signal transport service company.

1.12 Deleted January 12, 2007

2 General

2.1 Components

2.1.1 Except as indicated in 2.1.2, a component used in a station or a burglar-alarm or fire-alarm installation covered by this standard shall comply with the requirements for that component. See Appendix A for a list of standards covering components generally used to provide the services covered by this standard.

2.1.2 A component need not comply with a specific requirement that:

- a) Involves a feature or characteristic not needed in the application of the component in the product covered by this standard or
- b) Is superseded by a requirement in this standard.

2.1.3 A component shall be used in accordance with its recognized rating established for the intended conditions of use.

2.1.4 Specific components are recognized as being incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions for which they have been recognized.

2.2 Units of measurement

2.2.1 If a value for measurement is followed by a value in other units in parentheses, the second value may be only approximate. The first stated value is the requirement.

2.3 Undated references

2.3.1 Any undated reference to a code or standard in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

3 Glossary

3.1 General

3.1.1 For the purpose of this standard, the following definitions apply.

3.2 Definitions common to burglar- and fire-alarm systems

3.2.1 ACTIVE SYSTEM – A system that transmits one or both of the following signals to the central-station on a regular basis:

- a) A signal that the system has been disarmed and the protection removed (commonly referred to as "opened") or
- b) A signal that the system has been armed and the protection activated (commonly referred to as "closed").

If an alarm system sends opening and closing (disarm and arm) signals, it is considered to be an active system. The 24-hour supervisory check-in signal transmitted by a digital alarm communicator transmitter or a one-way radio (RF) transmitter does not make a system an active system. A system is considered inactive if the 24-hour supervisory check-in signal is the only signal normally transmitted on a daily basis.

3.2.2 ALARM AND SIGNAL TRANSPORT SERVICE – A service provided by a company to transmit signals from a protection system to either a station, law enforcement department, fire department, or the like. The service may be connected to multiple stations, law enforcement departments, fire departments, and the like. The service is independent of the protection systems and the organizations that receive the alarms and signals. A company providing this service provides the equipment, service, and maintenance for the transport system. The equipment used in the transport system shall comply with the requirements of the Standards for Control Units for Fire-Protective Signaling Systems, UL 864, and Central-Station Burglar-Alarm Units, UL 1610.

3.2.3 AUTOMATIC FIRE-ALARM SYSTEM – A fire detection system that will automatically detect and annunciate the presence of fire by the detection of one or more products of combustion. Annunciation is through a fire-alarm system control unit.

3.2.4 BUILDING, MULTIPLE OCCUPANCY – A building that is occupied by two or more independent tenants which do not have control of or association with each other.

3.2.5 BUILDING, SINGLE OCCUPANCY – A building that is occupied by and under the control of the alarm service company only. Any business in the building that is not directly associated with the alarm service shall be the business of, and controlled by, the alarm service company.

3.2.6 CENTRAL-STATION – A building or enclosed area within a building that houses an operating room and equipment used to provide central-station service to protected properties.

3.2.7 CENTRAL-STATION SERVICE – The use of a system or a group of systems in which the operation of circuits and devices at a protected property are signaled to, recorded in, and supervised from a central-station having trained operators who, upon the receipt of a signal, take such action as required by the nature of the signal received.

3.2.8 DERIVED CHANNEL – A signaling line circuit that uses the local leg of the public telephone company's switched network as an active multiplex channel, while simultaneously allowing the leg's use for normal telephone communications.

3.2.9 DIGITAL ALARM COMMUNICATOR RECEIVER (DACR) – A system component located at the central-station that will receive and display signals from a DACT (see 3.2.10).

3.2.10 DIGITAL ALARM COMMUNICATOR TRANSMITTER (DACT) – A system component located at the protected premises that will contact a DACR (see 3.2.9) through the public telephone company's switched network or through a cellular telephone system (dial system) and transmit the necessary data to identify the protected premises and the change of status. A DACT is either integral with the control unit that provides alarm or monitoring functions, or interfaces with a control unit that provides these functions.

3.2.11 DIGITAL ALARM RADIO RECEIVER (DARR) – A system component used in a DARS (see 3.2.12) to receive radio signals transmitted from a DART (see 3.2.13).

3.2.12 DIGITAL ALARM RADIO SYSTEM (DARS) – A one-way radio system that provides backup transmission for a DACT (see 3.2.10).

3.2.13 DIGITAL ALARM RADIO TRANSMITTER (DART) – A system component used in a DARS (see 3.2.12) to transmit signals to a DARR (see 3.2.11) via radio signals.

3.2.14 HUNT GROUP – A group of associated telephone lines within which an incoming call is automatically routed to an idle (not busy) telephone line for completion.

3.2.15 IDENTIFICATION CODE – The numeric, alpha numeric, alpha, word(s), or similar device used to identify a subscriber.

3.2.16 INACTIVE SYSTEM – A system that transmits a signal to the central-station only when an unintended condition exists or it is under test. Examples of inactive systems are fire- and holdup alarms, or a burglar alarm system supervising a protected premise without the use of opening and closing signals. The 24-hour supervisory check-in signal transmitted by a digital alarm communicator transmitter or a one-way radio (RF) transmitter does not make a system an active system. Such a system is considered inactive if that is the only signal transmitted on a daily basis.

3.2.17 KEY VAULT – An attack resistant container mounted outside of the protected premises that contains the key(s) that will allow entrance into the protected premises. The key vault can be opened with a mechanical key or a card key that is common to several key vaults and which is carried by the runner. Other emergency services, such as the fire department, law enforcement department and authorized private guard service may also have access to the key vault.

3.2.18 ONE-WAY RADIO ALARM SYSTEM (OWRAS) – A system in which alarm system signals are transmitted from a RAT (see 3.2.25) through a radio channel to at least two independently powered, independently operating, and separately located RARSRs (see 3.2.23) and which are then relayed to a

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub

RASSR (see 3.2.24). Signals may be transmitted through one RARSR provided they are also transmitted directly to the RASSR.

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

No Text on This Page

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

3.2.19 OPERATING ROOM – The physically enclosed area within a station that is physically secure and where the operators receive and act on the signals that are transmitted to the station.

3.2.20 OPERATOR – A trained employee stationed at the station whose duty is to provide immediate response to all signals received.

3.2.21 PERSONAL IDENTIFIER – A physical attribute of a person used as a means of verification of personnel identity, such as by retina scan, voice print, fingerprint, hand span, and the like.

3.2.22 POWER ROOM – The area(s) in which the primary and secondary power supplies are housed. This room may or may not include an engine driven generator or uninterruptible battery supply.

3.2.23 RADIO ALARM REPEATER STATION RECEIVER (RARSR) – A system component, used in a OWRAS (see 3.2.18) or a TWRAS (see 3.2.35), consisting of a radio receiver and transmitter located at a repeater station or subsidiary station. This component receives radio signals from a RAT (see 3.2.25) and retransmits them to another RARSR or to a RASSR (see 3.2.24) in a OWRAS (see 3.2.18), or relays signals between a RATR (see 3.2.26) and a RASSR in a TWRAS.

3.2.24 RADIO ALARM SUPERVISING STATION RECEIVER (RASSR) – A radio receiver or receiver/transmitter located at a station, to receive signals from a RARSR (see 3.2.23), RAT (see 3.2.25), or RATR (see 3.2.26) and either annunciates them or interfaces with an automation system that annunciates them.

3.2.25 RADIO ALARM TRANSMITTER (RAT) – A radio transmitter used in an OWRAS (see 3.2.18) located at a protected premises that will transmit signals to at least two independently powered, independently operating, and separately located RARSRs (see 3.2.23). Signals may be transmitted through one RARSR if they are also transmitted directly to the RASSR. A RAT either:

- a) Is integral with a control unit that provides alarm or monitoring functions or
- b) Interfaces with a control unit that provides these functions.

3.2.26 RADIO ALARM TRANSMITTER/RECEIVER (RATR) – A radio transmitter/receiver used in a TWRAS (see 3.2.35) that is located at a protected premises that will transmit and receive signals through at least two independently powered, independently operating, and separately located RARSRs (see 3.2.23) to and from a RASSR (see 3.2.24), or transmits and receives signals directly to and from a RASSR. A RATR either:

- a) Is integral with a control unit that provides alarm or monitoring functions or
- b) Interfaces with a control unit that provides these functions.

3.2.27 RUNNER – A person whose duties are to investigate signals from protected systems that require investigation.

3.2.28 RUNNER OR SERVICEPERSON STATION – A location separate from the central-station, subsidiary station, or service center, where runners or servicepersons are stationed awaiting instructions to respond to signals received at the central-station. Signals are not to be received at a runner or serviceperson station.

3.2.29 RUNNER SERVICE COMPANY – A company that is independent of the central-station which provides runners to respond to signals received by the station as required by this standard.

UL COPYRIGHTED MATERIAL –

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub

3.2.30 SERVICE CENTER – A location which may be separate from a central-station that provides required installation, maintenance, repair, and alarm investigator service to systems served by the company. Keys (where required) and maintenance records for protected premises are retained at the service center. Maintenance records are not required to be physically kept at the service center if they can be readily accessed at the service center from another location.

3.2.31 SERVICE VEHICLE – A vehicle that is used to provide required alarm investigator, installation, maintenance, and repair service to systems served by the company.

3.2.32 SERVICEPERSON – A person whose duties are to provide service to protected systems.

3.2.33 SUBSCRIBER – The user of a premise or item protected by a central-station burglar or fire-alarm system. An authorized representative of the user may also be considered a subscriber. For residential monitoring stations, a subscriber would be an occupant of a residence protected by the alarm system.

3.2.34 SUBSIDIARY STATION – A normally unattended physically secure facility linked by communication channels to a central-station or residential monitoring station. Signals from protected properties are transmitted to the subsidiary station and then relayed to the station. If the communication link between the subsidiary station and the station is out of service, the subsidiary station can be manned and operated as a central-station or residential monitoring station.

3.2.35 TWO-WAY RADIO ALARM SYSTEM (TWRAS) – A system in which alarm system signals are transmitted and received through a radio channel between a RATR (see 3.2.26) and a RASSR (see 3.2.24). The signals may or may not be relayed through a RARSR (see 3.2.23).

3.2.36 REPEATER STATION – Equipment, such as radio, which is used to relay signals from protected systems at remote location(s).

3.2.37 UNINTERRUPTIBLE BATTERY SUPPLY (UBS) – A direct current (DC) generator driven by a combustion engine. The DC output is used to provide the DC power required by an uninterruptible power supply (UPS) or by DC powered units.

3.2.38 UNINTERRUPTIBLE POWER SUPPLY (UPS) – Equipment that will continue to provide alternating current (AC) power to a load in the event of failure of the normal AC power source. A UPS may also provide a more constant voltage and frequency supply to the load. When the normal source of AC fails, the UPS is powered by a DC source from batteries, a UBS, or both.

3.3 Definitions common to burglar-alarm

3.3.1 ACKNOWLEDGMENT SIGNAL – An audible and/or visual signal that is sent to the subscriber by the station to notify the subscriber that a signal has been received indicating that the protection system has been properly armed. The acknowledgment signal is to be sent manually or automatically.

3.3.2 CENTRAL-STATION BURGLAR-ALARM COMPANY – A company that is engaged in the business of operating one or more central-stations that provide monitoring, record keeping, and reporting for signals received from central-station burglar-alarm systems. The company shall directly provide for equipment installation, inspection, testing, maintenance and repair service of central-station systems, and runners for alarm investigation service, or it may subcontract for these services. The company may also operate one or more subsidiary stations.

3.3.3 CENTRAL-STATION BURGLAR-ALARM SYSTEM – A system or group of systems consisting of control units, intrusion detection units, contacts, protective wiring, installation wiring, and the like, installed at a protected property in accordance with the Standard for Installation and Classification of Burglar and Holdup Alarm Systems, UL 681. When the system is armed, detection of an intrusion will cause a signal to be automatically transmitted to a central-station complying with this standard. Arming the system will cause a closing signal to be transmitted and disarming the system will cause an opening signal to be transmitted. The system is to be controlled and operated by a central-station burglar-alarm company.

3.3.4 LINE SECURITY, STANDARD AND ENCRYPTION – Methods of supervising the communication channel used to transmit signals between the protected premises and the central-station or residential monitoring station. This supervision serves to detect compromise attempts on the communication channel that are intended to not cause signals to be annunciated at the station and which would allow entry into the protected premises without initiating a signal at the station.

3.3.5 NORMAL OPERATION SIGNALS – A signal transmitted from the protected premises in accordance with established procedures to indicate to the station that the premises is being closed and armed (or opened and disarmed).

3.3.6 SUBSCRIBER'S BURGLAR-ALARM CONTROL UNIT – Equipment located at the protected premises that controls the protective circuit(s), transmits signals to the central-station or residential monitoring station, and allows the subscriber to arm and disarm the alarm system.

3.4 Definitions common to fire-alarm

3.4.1 CENTRAL-STATION FIRE-ALARM COMPANY – A company that is engaged in the business of operating one or more central-stations that provide monitoring, re-transmission of signals, and associated record keeping and reporting for signals from central-station fire-alarm systems. The station shall directly provide for equipment installation, inspection, testing, maintenance and repair service of central-station systems, runner service, and associated central-station services, or they may subcontract for these services. The company may also operate one or more subsidiary stations.

3.4.2 CENTRAL-STATION FIRE-ALARM SYSTEM – A system or group of systems installed in accordance with the requirements of the National Fire Alarm Code, NFPA 72, in which the operation of circuits and devices are transmitted automatically to, recorded in, maintained by, and supervised from a central-station having trained operators who, upon receipt of a signal, take action as required by NFPA 72. The system is to be controlled and operated by a central-station fire-alarm company.

3.4.3 FIRE-ALARM SERVICE – LOCAL COMPANY – A company that provides protected premises equipment installation, inspection, testing, maintenance and repair service of central-station fire-alarm systems with its own facilities and personnel in accordance with the requirements of the National Fire Alarm Code, NFPA 72. The company subcontracts the monitoring, re-transmission, and associated record keeping and reporting with a central-station. The required runner service is provided by the company or by the central-station.

3.5 Definitions common to residential monitoring stations

3.5.1 RESIDENTIAL MONITORING STATION COMPANY – A company that is engaged in the business of operating one or more residential monitoring stations that provide monitoring, record keeping, and reporting for signals from alarm systems. The company may also operate one or more subsidiary stations.

3.5.2 RESIDENTIAL MONITORING STATION – A building or enclosed area within a building that houses an operating room and equipment used to provide residential monitoring station service to protected properties.

FACILITIES AND EQUIPMENT

4 Building Construction Requirements

4.1 A building that houses a central-station or subsidiary station or residential monitoring station shall comply with one of the following:

- a) All bearing walls, floors, ceilings, columns, beams, girders, trusses, and arches have a one hour fire resistant rating or are constructed of the materials specified in 4.4;
- b) A sprinkler system, supervised by the station, installed in all parts of the building except for the operating room and power room; or
- c) The building is single occupancy and the exterior walls have a one hour fire resistant rating or are constructed of the materials specified in 4.4.

See also Figure 4.1.

4.2 In a multiple occupancy building, the walls, floors and ceilings enclosing the station shall have a one hour fire resistant rating or be constructed of the materials specified in 4.4.

4.3 The fire resistant rating of building construction shall:

- a) Meet the requirements of the local building code or
- b) Be determined by the test methods in the Standard for Fire Tests of Building Construction and Materials, UL 263.

4.4 Walls, floors, ceilings, beams, girders, trusses, and arches that are constructed of masonry or steel, or other materials deemed to have similar combustive characteristics are not required to have a fire resistant rating.

4.5 A building that houses a station shall either have a roof:

- a) With a one-hour, fire-resistant rating;
- b) Constructed of materials specified in 4.4; or
- c) Constructed of a combustible deck with a Class A roof covering complying with the Standard for Materials for Built-Up Roof Coverings, UL 55A, and the Standard for Tests for Fire Resistance of Roof Covering Materials, UL 790.

4.5 revised April 23, 1999.

4.6 Any door in an interior wall that is required to have a fire resistant rating shall have a minimum 3/4-hour fire resistant rating.

UL COPYRIGHTED MATERIAL –

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub

4.7 If a repeater station is located in a building:

- a) The building shall comply with the fire resistive requirements of this section or
- b) The repeater station shall be duplicated at separate sites and signals shall be able to be relayed through either site.

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL -

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

No Text on This Page

Document Was Downloaded By Rice, Shi SHIMISHENG
For Use By KUANTECH CO LTD
12039 : 8/1/2007 - 8:55 PM

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL




Documents

Document Sharing Hub

Figure 4.1
Building construction

Figure 4.1 revised October 1, 1997

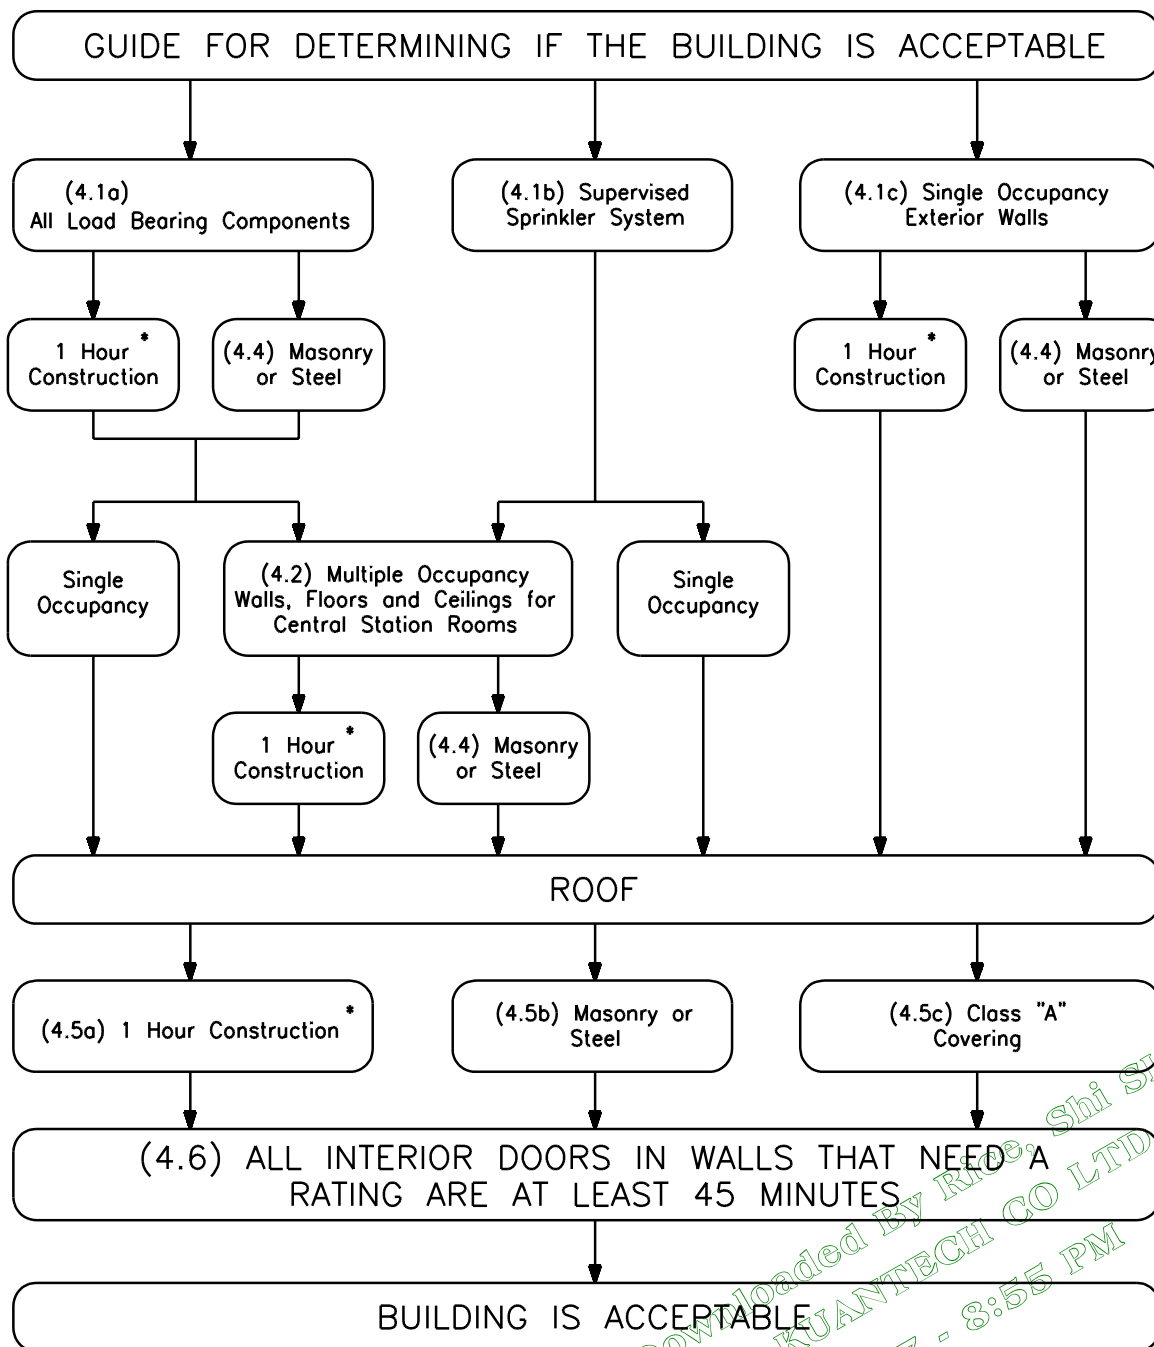

S3776

* May be determined by compliance with the local building code, or the Standard for Fire Tests of Building Construction and Materials, UL 263. See 4.3.

UL COPYRIGHTED MATERIAL -

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub

5 Physical Protection

5.1 The operating room of a central, subsidiary, and residential monitoring station, shall be completely enclosed within a boundary that is fixed in place and shall be protected at all times against attack or entrance by unauthorized persons. Walls enclosing an operating room shall extend from a fixed-in-place floor deck to a fixed-in-place ceiling. If a suspended ceiling is used, and the wall construction above the suspended ceiling is not required to serve as a fire stop, the portion of the wall above the suspended ceiling may be constructed of wire-mesh screening constructed of at least 0.053 inch (1.35 mm) expanded sheet steel or No. 10 AWG (0.102 inch diameter) (5.26 mm²) steel wire with openings not greater than 2 inches (51 mm).

Exception: Wall construction above a suspended ceiling is not required provided that solid walls, floor, and ceiling or roof enclose the entire alarm company quarters and the alarm company has controlled access throughout their quarters and there is a burglar-alarm system installed in areas surrounding the operating room that become unoccupied outside of normal business hours. The burglar-alarm system shall comply with Extent No. 3 in the Standard for Installation and Classification of Burglar and Holdup Alarm Systems, UL 681, shall be armed when those areas are unoccupied, and shall be monitored in the operating room.

5.1 effective January 1, 1999

5.2 Entrances into the operating room shall be kept locked at all times and arranged so that positive identification can be made by vision and voice of any person seeking admittance. If the person is unknown to the personnel, they shall be identified by an identification card or the like. If closed circuit television is used, a second means of manual visual identification shall be provided.

5.3 A door into the operating room of a station shall be one of the following:

- a) A recognized fire-resistant door and door frame;
- b) A solid or hollow metal door; or
- c) A solid wood, or solid wood core door with wood, plastic, or composition cladding a minimum of 1-1/2 inches (38 mm) thick.

5.4 The entry door shall be equipped with an automatic door closer without a hold open feature, and a locking means that cannot be changed to an unlocked condition.

5.5 If the door is locked with an electromagnetic lock, or similar device that requires electrical power to maintain the locking of the door, standby power or a backup mechanical lock shall be provided to maintain the locking of the door. The standby power shall be provided from the secondary power supply (See 9.5).

5.5 effective January 1, 1999

5.6 The operating room shall be arranged so that a person that is outside of the operating room in an area that is controlled by the station, cannot view the signal processing equipment so as to obtain information about an alarm system served by the station.

5.7 Any transparent window or panel that will provide a view of the operating room from a location that is not under the control of the station shall be made translucent or opaque by painting, screening, blinds, curtains, drapes, or similar coverings. Mirrored, tinted and one-way glass shall not be used for that purpose.

5.8 Any exterior opening, other than a door, that leads into the operating room from an area that is not controlled by the station, and which is accessible as defined in the Standard for Installation and Classification of Burglar and Holdup Alarm Systems, UL 681, shall be covered with either:

- a) Permanently-installed solid bars constructed of iron or steel at least 1/2 inch (12.7 mm) diameter, or rectangular with a minimum cross-section area of 0.25 square inch (40 mm²) with the minimum dimension 1/4 inch (6.4 mm). The space between bars shall be 4 inches (102 mm) or less and the space between supporting cross pieces shall be 18 inches (457 mm) or less. The supporting cross pieces shall be of the same material and dimension as the bars or larger;
- b) Wire-mesh screening constructed of at least 0.053 inch (1.35 mm) expanded sheet steel or No. 10 AWG (0.102 inch diameter) (5.26 mm²) steel wire with openings not greater than 2 inches (51 mm);
- c) Glazing complying with the Standard for Burglary Resisting Glazing Material, UL 972; or
- d) Glazing complying with the Standard for Bullet-Resisting Equipment, UL 752.

5.8 revised April 23, 1999

5.9 A subsidiary station repeater station shall be equipped with a burglar-alarm and automatic fire-alarm system connected to the central-station or residential monitoring station. The automatic fire-alarm system shall comply with the requirements in the National Fire Alarm Code, NFPA 72. The burglar-alarm system shall comply with Extent No. 3 in the Standard for Installation and Classification of Burglar and Holdup Alarm Systems, UL 681, and shall be armed when the station is unattended. See 11.7. A repeater station is not required to be equipped with a burglar-alarm and automatic fire-alarm system if the repeater station is duplicated at separate sites and signals are able to be relayed through either site.

6 Fire Protection

6.1 Portable fire extinguishers

6.1.1 Each station operating room shall be equipped with a minimum of two portable fire extinguishers rated 2-A or greater and two portable fire extinguishers rated 10-B:C or greater. Two multipurpose fire extinguishers rated 2-A:10-B:C will satisfy this requirement.

6.1.2 Each power room, battery room, and engine-driven generator room or enclosure shall be equipped with a minimum of one portable fire extinguisher rated 2-A or greater and one portable fire extinguisher rated 10-B:C or greater. One multipurpose fire extinguisher rated 2-A:10-B:C will satisfy this requirement.

6.1.3 Portable fire extinguishers shall comply with the Standards for 2-1/2-Gallon Stored-Pressure, Water-Type Fire Extinguishers, UL 626; Carbon-Dioxide Fire Extinguishers, UL 154; Dry Chemical Fire Extinguishers, UL 299; or Halogenated Agent Fire Extinguishers, UL 1093.

6.1.4 Fire extinguishers shall be located where they will be readily accessible and immediately available. A fire extinguisher intended to be used on electronic equipment, such as an automation system, shall be of the carbon dioxide or halogenated agent type and shall be located next to the automation system equipment. If the automation system equipment is in a separate room, the extinguisher shall be located outside of the room, within 3 feet (0.9 m) of the door. A separate room for automation equipment shall be provided with an automatic smoke and fire detection system with annunciation in the operating room.

6.1.5 A fire extinguisher shall be installed on the hanger or in the bracket supplied, or placed in a cabinet or a wall recess. A hanger or bracket shall be securely anchored to the mounting surface. If a cabinet is used, the door shall not be locked.

UL COPYRIGHTED MATERIAL -
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub

6.1.6 Fire extinguishers shall be maintained in accordance with the instructions marked on each extinguisher. Fire extinguishers shall be inspected once a year and the date of the inspection recorded in ink on a tag attached to the extinguisher.

6.1.7 The fire extinguisher for a power room, battery room, or engine-driven generator shall be located inside or just outside of the door to the room, within 3 feet (0.9 m). If the engine-driven generator is enclosed as specified in 9.13.2 or 9.13.6, the extinguisher shall be located within 10 feet (3.05 m) of the enclosure. If the enclosure for the engine-driven generator is provided with a personnel door or gate, the extinguisher shall be located inside or just outside the door or gate, within 3 feet.

6.2 Fire suppression system

6.2.1 If the automation system equipment is located in a separate room that is not normally occupied by personnel, and it is protected by a fire suppression system using a carbon-dioxide or halogenated or clean agent extinguishing agent, the discharge of the extinguishing agent shall either be automatic and an audible signal shall announce that it has been discharged, or the discharge of the extinguishing agent shall be under manual control. If under manual control, the automation system room shall be equipped with an automatic fire-alarm system that complies with the National Fire Alarm Code, NFPA 72, with annunciation in the operating room. Manual discharge is not acceptable in a subsidiary station.

6.2.1 effective January 1, 1999

6.3 Water sheds

6.3.1 A water shed shall be installed over any equipment that is sensitive to water damage if there is a possibility of water damage from overhead. The water shed may be permanent, or may be a movable waterproof cover or shield installed next to the equipment so that it can be immediately positioned by one person to protect the equipment. A movable waterproof cover shall only be used in a manned station.

6.4 Repeater station fire protection

6.4.1 A repeater station need not be provided with fire protection equipment, unless located in a building. A repeater station in a building is not required to be provided with fire protection equipment if it is duplicated at separate sites and signals are able to be relayed through either site.

6.5 Automatic fire-alarm system

6.5.1 A station shall have an automatic fire-alarm system installed in all areas not continuously occupied by alarm service company personnel, but which are under its control. The system shall comply with the National Fire Alarm Code, NFPA 72, and shall notify the operators of any trouble or fire condition that is detected.

6.5.1 effective January 1, 1999

7 Standby Lighting

7.1 Fixed standby lighting that is independent of the power source normally used for lighting, and which can be placed into service immediately, shall be provided in:

- a) The operating room of a station;
- b) Each runner and serviceperson station; and

UL COPYRIGHTED MATERIAL -

NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents

Document Sharing Hub