

UL 873

ISBN 1-55989-682-5

Temperature-Indicating and -Regulating Equipment

Underwriters Laboratories Inc. (UL)
333 Pfingsten Road
Northbrook, IL 60062-2096

UL Standard for Safety for Temperature-Indicating and -Regulating Equipment, UL 873

Eleventh Edition, Dated December 22, 1994

Revisions: This Standard contains revisions through and including January 16, 2004.

Summary of Topics

Numerous revisions are being adopted into UL 873. Some of these revisions are 1) the grounding symbol can now be used to identify a grounding conductor, 2) Section 35, Separation of Circuits, has been extensively revised, 3) requirements covering the endurance test have been revised, and 4) requirements covering the sizing of wiring terminals or leads have been revised.

UL Standards for Safety are developed and maintained in the Standard Generalized Markup Language (SGML). SGML -- an international standard (ISO 8879-1986) -- is a descriptive markup language that describes a document's structure and purpose, rather than its physical appearance on a page. Due to formatting differences resulting from the use of UL's new electronic publishing system, please note that additional pages (on which no requirements have been changed) may be included in revision pages due to relocation of existing text and reformatting of the Standard.

Text that has been changed in any manner is marked with a vertical line in the margin. Changes in requirements are marked with a vertical line in the margin and are followed by an effective date note indicating the date of publication or the date on which the changed requirement becomes effective.

The new and revised requirements are substantially in accordance with UL's Bulletin(s) on this subject dated November 4, 1999, July 6, 2001, November 21, 2001, and April 18, 2003. The bulletin(s) is now obsolete and may be discarded.

The revisions dated January 16, 2004 include a reprinted title page (page1) for this Standard.

As indicated on the title page (page1), this UL Standard for Safety has been adopted by the Department of Defense.

The master for this Standard at UL's Northbrook Office is the official document insofar as it relates to a UL service and the compliance of a product with respect to the requirements for that product and service, or if there are questions regarding the accuracy of this Standard.

UL's Standards for Safety are copyrighted by UL. Neither a printed copy of a Standard, nor the distribution diskette for a Standard-on-Diskette and the file for the Standard on the distribution diskette should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

Revisions of UL Standards for Safety are issued from time to time. A UL Standard for Safety is current only if it incorporates the most recently adopted revisions.

UL provides this Standard “as is” without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL’s liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

UL will attempt to answer support requests concerning electronic versions of its Standards. However, this support service is offered on a reasonable efforts basis only, and UL may not be able to resolve every support request. UL supports the electronic versions of its Standards only if they are used under the conditions and operating systems for which it is intended. UL’s support policies may change from time-to-time without notification.

UL reserves the right to change the format, presentation, file types and formats, delivery methods and formats, and the like of both its printed and electronic Standards without prior notice.

Purchasers of the electronic versions of UL’s Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgement (including reasonable attorney’s fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser’s computer system.

If a single-user version electronic Standard was purchased, one copy of this Standard may be stored on the hard disk of a single personal computer, or on a single LAN file-server or the permanent storage device of a multiple-user computer in such a manner that this Standard may only be accessed by one user at a time and for which there is no possibility of multiple concurrent access.

If a multiple-user version electronic Standard was purchased, one copy of the Standard may be stored on a single LAN file-server, or on the permanent storage device of a multiple-user computer, or on an Intranet server. The number of concurrent users shall not exceed the number of users authorized.

Electronic Standards are intended for on-line use, such as for viewing the requirements of a Standard, conducting a word search, and the like. Only one copy of the Standard may be printed from each single-user version of an electronic Standard. Only one copy of the Standard may be printed for each authorized user of a multiple-user version of an electronic Standard. Because of differences in the computer/software/printer setup used by UL and those of electronic Standards purchasers, the printed copy obtained by a purchaser may not look exactly like the on-line screen view or the printed Standard.

An employee of an organization purchasing a UL Standard can make a copy of the page or pages being viewed for their own fair and/or practical internal use.

The requirements in this Standard are now in effect, except for those paragraphs, sections, tables, figures, and/or other elements of the Standard having future effective dates as indicated in the note following the affected item. The prior text for requirements that have been revised and that have a future effective date are located after the Standard, and are preceded by a “SUPERSEDED REQUIREMENTS” notice.

New product submittals made prior to a specified future effective date will be judged under all of the requirements in this Standard including those requirements with a specified future effective date, unless the applicant specifically requests that the product be judged under the current requirements. However, if

the applicant elects this option, it should be noted that compliance with all the requirements in this Standard will be required as a condition of continued Listing, and Follow-Up Services after the effective date, and understanding of this should be signified in writing.

Copyright © 2004 Underwriters Laboratories Inc.

This Standard consists of pages dated as shown in the following checklist:

Page	Date
1-4D	January 16, 2004
5	May 4, 2001
6	March 4, 1999
7	December 22, 1994
8-10B	May 4, 2001
11-16	December 22, 1994
17	October 24, 1995
18	June 2, 1998
19-20	December 22, 1994
21	June 2, 1998
22-22B	May 4, 2001
23	June 2, 1998
24-26	December 22, 1994
27-28B	January 16, 2004
29	December 22, 1994
30-31	October 24, 1995
32-33	January 16, 2004
34-37	December 22, 1994
38-38B	May 4, 2001
39-40	December 22, 1994
41-42B	January 16, 2004
43-51	December 22, 1994
52-52B	May 4, 2001
53-57	December 22, 1994
58-59	March 4, 1999
60-63	December 22, 1994
64-66D	January 16, 2004
67-70	December 22, 1994
71-72B	May 4, 2001
73-74B	June 2, 1998
75-76B	May 4, 2001
77-78	December 22, 1994
79-80B	June 2, 1998
81	December 22, 1994
82	June 2, 1998
83	December 22, 1994
84	January 16, 2004
85	December 22, 1994
86-86B	January 16, 2004
87-88	December 22, 1994
89	January 16, 2004
90	May 4, 2001
91-92B	January 16, 2004
93-99	December 22, 1994
100-100B	January 16, 2004
101-109	December 22, 1994
110	October 24, 1995
111-112B	May 4, 2001
113	December 22, 1994

114	January 16, 2004
114A-114B	March 4, 1999
115-116	December 22, 1994
117-119	May 4, 2001
120-122A	January 16, 2004
122B	May 4, 2001
123-141	December 22, 1994
142-146B	January 16, 2004
147-153	December 22, 1994
154-154B	May 4, 2001
155	December 22, 1994
156-156B	January 16, 2004
157-162	December 22, 1994
163	June 2, 1998
164-165	December 22, 1994
166-166B	May 4, 2001
167	June 2, 1998
168-170	December 22, 1994
171-172B	March 4, 1999
173	December 22, 1994
174-178	May 4, 2001
A1	June 2, 1998
A2	December 22, 1994
CRG1-CRG4	June 2, 1998
CRG5-CRG6	January 16, 2004

No Text on This Page

DECEMBER 22, 1994

(Title Page Reprinted: January 16, 2004)

1

UL 873

Standard for Temperature-Indicating and -Regulating Equipment

First Edition – August, 1942
Second Edition – March, 1945
Third Edition – January, 1947
Fourth Edition – June, 1953
Fifth Edition – December, 1956
Sixth Edition – December, 1958
Seventh Edition – May, 1970
Eighth Edition – September, 1972
Ninth Edition – May, 1979
Tenth Edition – September, 1988

Eleventh Edition

December 22, 1994

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

The Department of Defense (DoD) has adopted UL 873 on January 17, 1992. The publication of revised pages or a new edition of this Standard will not invalidate the DoD adoption.

Revisions of this Standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest set of revised requirements.

ISBN 1-55989-682-5

COPYRIGHT © 1979, 2004 UNDERWRITERS LABORATORIES INC.

No Text on This Page

CONTENTS

FOREWORD	6
-----------------------	---

INTRODUCTION

1 Scope	7
2 Glossary	9
3 Units of Measurement	10
4 Components	10
5 References	10

CONSTRUCTION

6 General	10
7 Frame and Enclosure	10A
7.1 General	10A
7.2 Accessibility of live parts	11
7.3 Covers	13
7.4 Transformers	14
7.5 Cast metal	14
7.6 Sheet metal	14
7.7 Polymeric	15
7.8 Windows	18
7.9 Room thermostats	19
7.10 Openings	19
7.11 Screens and expanded metal	22
7.12 Wiring openings	22A
7.13 Raintight and rainproof enclosures	24
8 Mounting	25
9 Parts Containing Liquid Metal	25
10 Adjustment Stop	25
11 Operating Mechanism	25
12 Reset Mechanism – Limiting Control	28
13 Means for Calibration	28A
14 Protection Against Corrosion	29
15 Insulating Material	32
16 Supply Connections	32
16.1 General	32
16.2 Equipment permanently connected electrically	32
16.3 Cord and plug connected portable equipment	36
16.4 Stationary equipment	36
17 Current-Carrying Parts	37
18 Switches	38
19 Internal Wiring	38
20 Low-Voltage External Wiring Requirements	40
21 Grounding	40
21.1 General	40
21.2 Grounding means	40
21.3 Equipment permanently connected electrically	41
21.4 Terminals and leads	42
22 Bonding of Internal Parts	43

22.1	General	.43
22.2	Construction and connection	.44
23	Protection of Users and Service Personnel	.46
23.1	General	.46
23.2	Mechanical servicing	.47
23.3	Electrical servicing	.48
24	Protection Against Injury to Persons	.49
24.1	Scope	.49
24.2	Sharp corners and edges	.49
24.3	Moving parts	.49
24.4	Temperature	.49
24.5	Mounting devices	.50
24.6	Strength of parts	.50
25	Capacitors	.51
26	Fuseholders	.51
27	Receptacles	.51
28	Protection of Control-Circuits	.52
28.1	Conductors	.52
28.2	Transformers	.54
29	Short-Circuit, Ground-Fault, Overload, and Thermal Protection	.55
30	Mercury-Tube Switches	.55
31	Coil Windings	.55
32	Spacings	.55
32.1	General	.55
32.2	Line-voltage circuits	.56
32.3	Magnet coil windings	.60
32.4	Low-voltage circuits	.60
32.5	Isolated limited secondary circuits	.61
33	Alternate Spacings – Clearances and Creepage Distances	.62
34	Wiring Space	.63
35	Separation of Circuits	.64
35.1	Separation between different internal wiring circuits (factory-installed conductors)	.64
35.2	Separation between different field wiring circuits (field-installed conductors)	.64
35.3	Separation between field wiring circuits (field-installed conductors) and internal wiring circuits (factory-installed conductors)	.66
35.4	Segregation Methods	.66A
35.5	Separation Methods	.66B
36	Class 2 Power Sources and Circuits	.66B
36.1	General	.66B
36.2	Interconnections	.66C
36.3	Circuits	.66C
36.4	Transformers	.66C
36.5	Power limiting components	.66D
36.6	Overcurrent protection components	.66D
37	Barriers	.67

PERFORMANCE

38	General	.67
38.1	Samples	.67
38.2	Electric heat thermostat	.68
38.3	Controller	.69
38.4	Baseboard heater controls	.69

38.5 Relays	69
38.6 Electric range controls	70
38.7 Auxiliary electric range controls	75
38.8 Conditioning at elevated temperature – household range control switch body	75
38.9 Temperature-limiting controls for electric ranges	76
39 Power Input	76
40 Temperature Test	76A
41 Leakage Current Test	80
42 Leakage Current Following Humidity Conditioning Test	83
43 Operation Test	83
44 Calibration-Verification Test	84
45 Overload Test	85
46 Endurance Test	90
47 Dielectric Voltage-Withstand Test	93
47.1 General	93
47.2 Induced potential	94
47.3 Induced potential repeated	94
48 Volt-Ampere Capacity Test	94
49 Burnout Test	95
50 Short Circuit Test	96
50.1 Mercury-tube switch	96
50.2 Conductor	96
50.3 Equipment for motor control	97
51 Parts Containing Liquid Metal Test	97
52 Two-Step Operation Surface-Unit Controls Test	98
52.1 General	98
52.2 Push- and pull-and-turn controls	98
52.3 Other types of controls	99
53 Strain-Relief Test	99
54 Accelerated Aging Tests on Gaskets, Sealing Compounds, and Adhesives	99
55 Metallic Coating Thickness Test	101
56 Rain Test	103
57 Time-Calibration Verification Test	106
57.1 General	106
57.2 Bimetal-heater design	106
57.3 Initial time-calibration-verification Test I	106
57.4 Initial time-calibration-verification Test II	107
57.5 Endurance	107
57.6 Time-verification and dielectric voltage-withstand tests after endurance	107
57.7 Other designs	107
58 Snap-On Covers Test	107
59 Bonding Conductor Tests	108
59.1 Overcurrent	108
59.2 Resistance	109
60 Permanence of Marking Test	109
60.1 General	109
60.2 Oven-aging	109
60.3 Immersion	110
60.4 Standard-atmosphere	110
60.5 Unusual condition exposure	110
60.6 Humidity	110
61 Strength of Adjustment Stop Test	110
62 Polymeric Materials Tests	112

62.1	General	112
62.2	Flammability of enclosure – 5 inch (127 mm) flame	113
62.3	Thermal aging	115
62.4	Exposure to ultraviolet light	116
62.5	Water exposure and immersion	117
62.6	Volume resistivity	117
62.7	Resistance to hot-wire ignition	118
62.8	Heat deflection temperature	118
62.9	Resistance to impact	118
62.10	Crush resistance	119
62.11	Mold-stress evaluation	120
62.12	Dielectric strength	120
62.13	Conduit connections	120
62.14	Knockouts	122
62.15	Abnormal operation	122
62.16	Resistance to ignition	122A
62.17	Creep and overcurrent	122A
63	Class 2 Power Sources and Circuit Tests	122A
63.1	General	122A
63.2	Ambient air temperature	127
63.3	Open-circuit secondary voltage	127
63.4	Maximum current of inherently limited power source	130
63.5	Maximum current of not inherently limited power source	136
63.6	Maximum power of not inherently limited power source	136
63.7	Calibration of overcurrent-protective devices	137
63.8	Rated secondary output	137
63.9	Rated output heating	138
63.10	Dielectric voltage withstand	138
63.11	Component breakdown	138
63.12	Overload heating	138
63.13	Repeat dielectric voltage withstand	140
63.14	Overload of overcurrent- or overtemperature-protective devices	140
63.15	Endurance of automatic-reset overtemperature-protective devices	140
64	Isolated-Limited Secondary and Non-Class 2 Circuits Tests	141

MANUFACTURING AND PRODUCTION TESTS

65	Details	141
65.1	General	141
65.2	Marked-off position	142
66	Grounding Continuity	142

RATING

67	General	142
68	Class 2 Power Sources and Circuits	144

MARKING

69	General	144
70	Wiring	146A
71	Calibration Setting	147
72	Elevated Air Temperature	148

73 Location	149
74 Cautionary Markings	149
75 Class 2 Power Sources and Circuits	150
76 Instructions	151

SPECIAL-PURPOSE DEVICES

77 Scope	151
78 Fan/Heat Sequencers	151
78.1 Scope	151
78.2 General	152
78.3 Performance	153
78.4 Mechanical and production tests	155
78.5 Rating	155
78.6 Marking	155
79 Fluorescent-Lamp-Ballast Protectors	155
79.1 Scope	155
79.2 General	155
79.3 Construction	155
79.4 Performance	156
79.5 Manufacturing and production tests	157
79.6 Marking	157
80 Control-Circuit Temperature-Limiting Devices for Temperature Protection of Enclosures of Motors and Generators for Use in Hazardous Location	157
80.1 Scope	157
80.2 General	158
80.3 Construction	158
80.4 Performance	158
80.5 Manufacturing and production tests	159
80.6 Rating	159
80.7 Marking	159
81 Single-Operation Devices	160
81.1 Scope	160
81.2 General	160
81.3 Operation mechanism	160
81.4 Construction	160
81.5 Performance	161
81.6 Manufacturer's inspection and test program	162
81.7 Ratings	162
81.8 Marking	162
82 Thermal Protective Devices for Lighting Fixtures	162
82.1 Scope	162
82.2 Enclosures	163
82.3 Accessibility	163
82.4 Open hole	164
82.5 Insulating materials	164
82.6 Wiring connections	164
82.7 Mounting hardware	165
82.8 Spacings	165
82.9 Performance	165
82.10 Manufacturing and production-line tests	172A
82.11 Ratings	173
82.12 Markings	173

83	Controllers for Solar-Energy Systems	173
83.1	Scope	173
83.2	Supply connections	173
83.3	Marking	174
83.4	Instructions	174
84	Temperature-Regulating Thermostats for Household Drip-Type Coffee Makers	175
84.1	Scope	175
84.1A	Glossary	175
84.2	Construction	176
84.3	Performance	176
84.4	Ratings	178
84.5	Markings	178

APPENDIX A

Standards for Components.....	A1
-------------------------------	----

CANADIAN REQUIREMENTS COMPARISON GUIDE CRG 873

UL AND CANADIAN STANDARDS FOR TEMPERATURE-INDICATING AND -REGULATING EQUIPMENT	CRG1
--	------

No Text on This Page

FOREWORD

A. This Standard contains basic requirements for products covered by Underwriters Laboratories Inc. (UL) under its Follow-Up Service for this category within the limitations given below and in the Scope section of this Standard. These requirements are based upon sound engineering principles, research, records of tests and field experience, and an appreciation of the problems of manufacture, installation, and use derived from consultation with and information obtained from manufacturers, users, inspection authorities, and others having specialized experience. They are subject to revision as further experience and investigation may show is necessary or desirable.

B. The observance of the requirements of this Standard by a manufacturer is one of the conditions of the continued coverage of the manufacturer's product.

C. A product which complies with the text of this Standard will not necessarily be judged to comply with the Standard if, when examined and tested, it is found to have other features which impair the level of safety contemplated by these requirements.

D. A product employing materials or having forms of construction which conflict with specific requirements of the Standard cannot be judged to comply with the Standard. A product employing materials or having forms of construction not addressed by this Standard may be examined and tested according to the intent of the requirements and, if found to meet the intent of this Standard, may be judged to comply with the Standard.

E. UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. The opinions and findings of UL represent its professional judgment given with due consideration to the necessary limitations of practical operation and state of the art at the time the Standard is processed. UL shall not be responsible to anyone for the use of or reliance upon this Standard by anyone. UL shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Standard.

F. Many tests required by the Standards of UL are inherently hazardous and adequate safeguards for personnel and property shall be employed in conducting such tests.

INTRODUCTION

1 Scope

1.1 These requirements cover electrical equipment for control of air-conditioning, heating, cooking, refrigeration, and humidity, rated 600 volts or less, to be used in ordinary locations in accordance with the National Electrical Code, NFPA 70.

1.2 These requirements cover general-use equipment for field-installation and controls intended to be factory installed on or in certain appliances as safety, limiting, or operating controls. These controls respond directly or indirectly to changes in temperature, humidity, or pressure to effect control of equipment or appliance operation. Devices covered by these requirements include:

a) Refrigeration Controllers – Humidistats for factory installation on or in refrigeration equipment; pressure, temperature, pneumatic pressure, motor, timer, bimetallic-heater, magnetically-operated controls, and the like, and combinations thereof in control panels with or without transformers. See 1.4.

b) Industrial Operating Controls – Temperature controllers for industrial, farm, and boiler room applications; snow melting controls; return-duct humidistats; humidity controllers; pneumatic pressure regulators; transformer (low-voltage secondary) relays; pneumatic pressure, bimetallic-heater, motor, timer, and magnetically operated sequence switches; stoker controls; indicating and recording controls; and motor operators for actuating air dampers. These requirements do not cover output connected apparatus such as dampers, linkages, or valves.

c) Residential Operating Controls – Room thermostats, room humidistats, and other operating controls for residential heating and cooling appliances.

d) Controls for Factory Installation on or in Appliances –

1) Controls as mentioned in (a) – (c) but specifically intended for use on, in, or as a part of the end-use equipment.

2) Electric water-heater controls intended to regulate or limit water temperature.

3) Other controls including door-interlock thermostats for self-cleaning ovens; baseboard heater temperature-limiting controls; humidifier controls; fan thermostats; and temperature-regulating and -limiting thermostats for electric heating equipment such as clothes dryers, air heaters, household and commercial cooking appliances, beauty-parlor equipment, steam and dry bath heaters, and ranges (controlling oven or surface elements).

1.3 Certain safety controls, and safety control circuits on operating controls, are investigated under the requirements in this standard, insofar as they apply, and also under the applicable requirements for limit controls.

1.4 The following devices are among those considered to be refrigeration controllers:

- a) A control that either directly or indirectly controls the starting and stopping of a compressor motor of refrigeration or air-conditioning equipment because of variations in temperature, pressure, refrigerant level, or the like.
- b) A pressure limiting device and a defrost temperature-limiting device for refrigeration or air-conditioning equipment.
- c) An auxiliary device, such as a defrost timing control, a defrost temperature regulating control, a start winding relay for a compressor motor, a control or defrost or heat pump change-over, fan or pump motor, vane or load capacity regulator, or a similar device that primarily serves refrigeration or air-conditioning equipment.
- d) A control panel that, incorporates one or more of the functions described in (a) – (c) for programming refrigeration or air-conditioning equipment.

1.5 A wall-mounted room thermostat not intended for mounting in or on refrigeration or air-conditioning equipment is investigated as a thermostat and not as a refrigeration controller.

1.6 Industrial temperature-indicating and -regulating controls include controls that are intended, among other applications, for installation in or on industrial apparatus, or for boiler or furnace room, farm, outdoor, and comparable locations that may not always be clean and dry.

1.7 A residential control is one intended for indoor comfort control use in clean, dry, nonindustrial environments, such as dwellings, offices, and stores.

1.8 A humidistat is investigated in the same manner as a thermostat.

1.9 Requirements for controls intended to be factory installed on or in appliances may include requirements appropriate for the end-use appliance. The spacing requirements for several such controls are specified in Table 32.1.

1.10 These requirements do not cover primary safety or limit controls for gas, oil, or electric-fired central-heating furnaces or boilers; duct heaters; oil or gas burners; or stokers; nor do they cover controls for oil pumps and oil level regulators; boiler-feed or low-water cut-offs; or furnace fan or boiler circulators.

1.11 These requirements do not cover low-voltage thermostats, damper controls or similar devices intended for connection only to a low-voltage circuit of limited power supplied by a primary battery or by a Class 2 transformer. An assembly consisting of a line-voltage transformer with a low-voltage secondary incorporated as an integral part of a control, such as a thermostat or a damper control, is considered to be within the scope of these requirements. See 6.1.

1.12 A product that contains features, characteristics, components, materials, or systems new or different from those covered by the requirements in this standard, and that involves a risk of fire or of electric shock or injury to persons shall be evaluated using appropriate additional component and end-product requirements to maintain the level of safety as originally anticipated by the intent of this standard. A product whose features, characteristics, components, materials, or systems conflict with specific requirements or provisions of this standard does not comply with this standard. Revision of requirements shall be proposed and adopted in conformance with the methods employed for development, revision, and implementation of this standard.

1.12 revised May 4, 2001

2 Glossary

2.1 For the purpose of this standard the following definitions apply.

2.2 **CLASS 2 TRANSFORMER** – A stepdown transformer of the low-secondary-voltage type (30 volts or less) rated for use with Class 2 remote-control circuits, low-energy power circuits, and signal circuits (including bell or buzzer circuits and the like) in accordance with the National Electrical Code, ANSI/NFPA 70-1993. Unless such a transformer is of the energy-limiting type having sufficient winding impedance to limit the current output to a specified maximum value, it is required to be provided with a fuse or other overcurrent-protective device rated for the application.

2.3 **EQUIVALENT SELF-HEATING THERMAL PROTECTOR** – A SHTP that is identified as being equivalent with another SHTP and is intended to be used in a lighting fixture interchangeably with the other SHTP without adversely affecting the compliance of the lighting fixture with the requirements for the fixture.

2.4 **ISOLATED-LIMITED-ENERGY CIRCUIT** – A circuit derived from an isolated secondary winding of a transformer having a maximum capacity of 100 volt-amperes and an open-circuit secondary voltage rating not exceeding 1000 volts.

2.5 **LINE-VOLTAGE CIRCUIT** – A circuit involving a potential of not more than 600 volts and having circuit characteristics in excess of a low-voltage or isolated-limited-energy circuit.

2.6 **LOW-VOLTAGE CIRCUIT** – A circuit involving a potential of not more than 30 volts and supplied by a primary battery, by a standard Class 2 transformer, or by a combination of a transformer and a fixed impedance that, as a unit, complies with all the performance requirements for a Class 2 transformer. A circuit derived from a line-voltage circuit by connecting resistance in series with the supply circuit as a means of limiting the voltage and current is not considered to be a low-voltage circuit.

2.7 **PORTABLE EQUIPMENT** – Cord and plug connected equipment that is capable of being carried or moved about.

2.8 **SELF-HEATING THERMAL PROTECTOR (SHTP)** – A thermal protective device consisting of a temperature sensitive switching element and a load voltage heater within a common housing. When mounted on a non-Type IC recessed fixture, the SHTP is intended to cycle under field related abnormal heating conditions.

2.9 **STATIONARY EQUIPMENT** – Cord and plug connected equipment that is intended to be fastened in place, or located in a dedicated space.

2.10 **THERMAL PROTECTOR** – A thermal protective device consisting of a temperature sensitive switching element with or without a series heater within a common housing.

3 Units of Measurement

3.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

3.1 revised May 4, 2001

4 Components

4.1 Except as indicated in 4.2, a component of a product covered by this standard shall comply with the requirements for that component. See Appendix A for a list of standards covering components generally used in the products covered by this standard.

4.2 A component is not required to comply with a specific requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

4.2 revised May 4, 2001

4.3 A component shall be used in accordance with its rating established for the intended conditions of use.

4.3 revised May 4, 2001

4.4 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

4.4 revised May 4, 2001

5 References

5.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

CONSTRUCTION

6 General

6.1 A temperature-indicating or -regulating device or system that falls within the scope of 1.11, but has a maximum secondary potential of more than 30 volts or a maximum secondary output more than that specified for a standard Class 2 transformer under any service condition or load shall be investigated under conditions of intended service to determine whether it is acceptable for the intended application.

6.1 revised June 2, 1998

6.2 An electronic or solid-state circuit used in a back-up, limiting, or other safety control, including controls that require a calibration test, shall acceptably complete a component evaluation of electronic devices and is investigated on the basis of its compliance with the requirements in this standard, in addition to complying with the specific requirements for the control.

7 Frame and Enclosure

7.1 General

7.1.1 Temperature-indicating and -regulating equipment shall be formed and assembled so that it will have the strength and rigidity necessary to resist the abuses to which it may be subjected, without increasing the risk of fire, electric shock, or injury to persons due to total or partial collapse with resulting reduction of spacings, loosening or displacement of parts, or other serious defects.

No Text on This Page

7.2 Accessibility of live parts

7.2.1 Electrical parts of a device, other than a supply cord or low-voltage terminals, shall be located or enclosed to reduce the risk of unintentional contact with an uninsulated live part. Additionally, electrical parts shall be located or enclosed so that protection against unintentional contact or shorting of live parts that could result in a malfunction of the controlled equipment is provided. For the purpose of these requirements, film-coated wire is considered to be an uninsulated live part.


Exception: An enclosure is not required for a device intended for assembly as part of another device.

7.2.1 effective August 28, 1995

7.2.2 An opening in an enclosure of a control is acceptable if an accessibility probe as illustrated in Figure 7.1, when inserted into the opening, cannot be made to touch any part that involves a risk of electric shock to the end-user or service personnel. However, in no case shall the opening be large enough to permit the entrance of a 1 inch (25.4 mm) diameter rod.

7.2.2 effective February 28, 1997

Figure 7.1
Accessibility probe

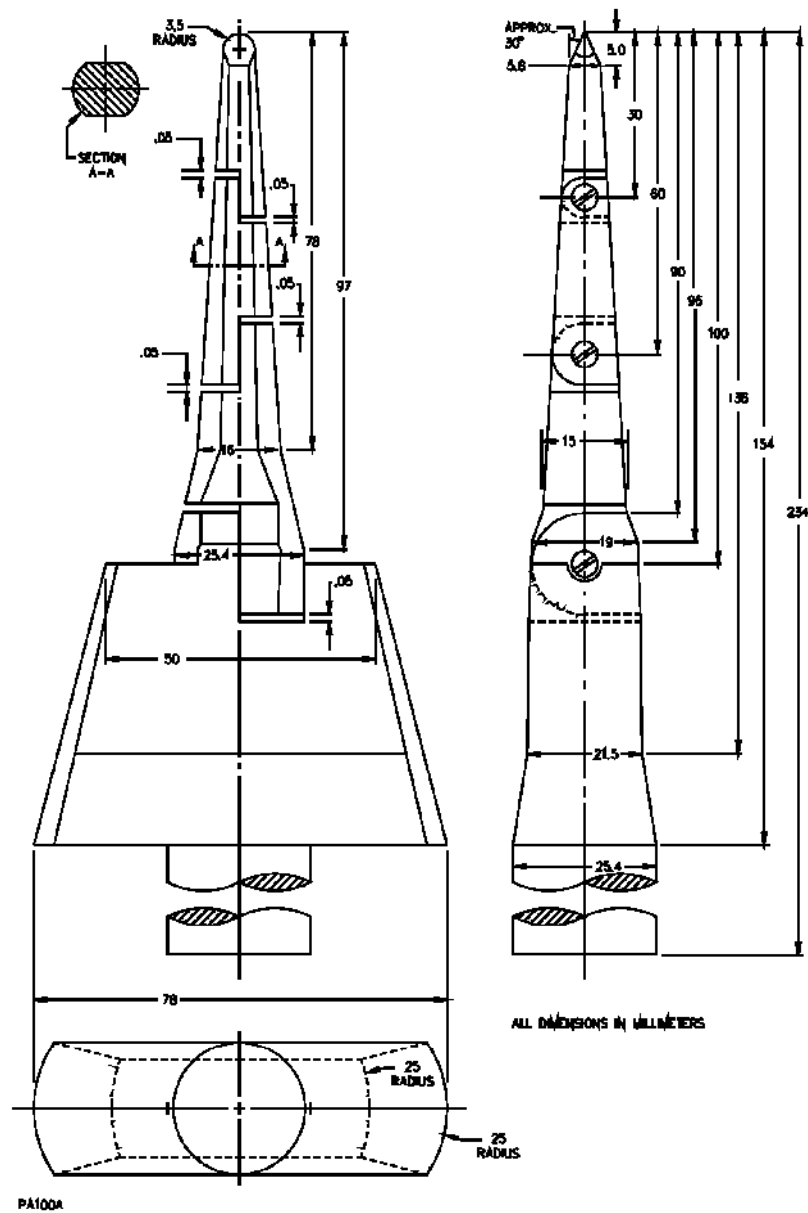

Note: All length dimensions in millimeters

7.2.3 The accessibility probe shall be articulated into any configuration and shall be rotated or angled to any position before, during, or after insertion into the opening, and the penetration shall be to any depth allowed by the opening size, including minimal depth combined with maximum articulation.

7.2.3 effective February 28, 1997

7.2.4 If any part of the enclosure must be opened or removed as part of normal operation, regular adjustment, or regular or required maintenance (set point adjustment, timer or time of day clock adjustment, battery replacement, and the like) with or without the use of tools, or can be opened or removed without the use of tools, the accessibility probe is to be applied without the part in place.

7.2.4 effective February 28, 1997

7.2.5 *Deleted effective August 28, 1995*

7.2.5 effective August 28, 1995

7.3 Covers

7.3.1 An enclosure and a part of an enclosure such as a door, cover, or tank, shall be provided with means for firmly securing it in place.

7.3.2 Sheet-metal screws threading directly into metal shall not be used to attach a cover, door, or other part removed to install field wiring or for operation of the equipment. Sheet-metal screws may thread into sheet-metal nuts that are permanently mounted and protected against corrosion, and machine screws and self-tapping machine screws may thread directly into sheet-metal walls. See 19.12.

7.3.3 Sheet-metal screws mounting internal components that are not removed for installation or operation may thread directly into metal.

7.3.4 An enclosure cover shall be hinged if it gives access to fuses, thermal cutouts, or any other overload-protective device, the functioning of which requires renewal, or if it is necessary to open the cover in connection with intended operation of the device.

7.3.5 A door or cover giving access to a fuse or thermal cutout in other than a low-voltage circuit shall shut closely against a 1/4-inch rabbet or the equivalent, have turned flanges for the full length of four edges, or have angle strips fastened to it. Flanges or angle strips shall fit closely with the outside of the walls of the box proper and shall overlap the edges of the box not less than 1/2 inch (12.7 mm). A construction that affords equivalent protection or a combination of flange and rabbet is acceptable.

7.3.6 A strip used to provide a rabbet and an angle strip fastened to the edges of a door shall be secured at not less than two points, not more than 1-1/2 inches (38.1 mm) from each end of each strip and at points between these end fastenings not more than 6 inches (152 mm) apart.

7.3.7 A hinged cover shall not depend solely upon screws or other similar means requiring the use of a tool to hold it closed, but shall be provided with a spring latch or catch.

Exception: A cover that is hinged but is not required to be hinged for holding the cover may be held closed by a clasp, a sliding latch, or other means.

7.3.8 A snap-on cover that gives access to bare live parts and that does not require a tool for removal shall withstand the tests described in Snap-On Covers Test, Section 58.

7.3.9 The continuity of a bonding means for a snap-on or fastener-attached cover shall comply with the requirements in Bonding of Internal Parts, Section 22.

7.4 Transformers

7.4.1 A transformer shall be housed within its own enclosure, within the main enclosure of temperature-indicating and -regulating equipment, or within a combination of the two.

7.4.2 A sheet-steel transformer enclosure shall have a thickness of not less than 0.026 inch (0.66 mm) if uncoated and not less than 0.029 inch (0.74 mm) if galvanized.

Exception: Sheet steel having a thickness of not less than 0.020 inch (0.51 mm) if uncoated and not less than 0.023 inch (0.58 mm) if galvanized may be used for a drawn end bell having maximum dimensions of 2-1/4 inches (57.2 mm) on the flat portion and 1-1/2 inches (38.1 mm) at the base of the drawn portion.

7.4.3 A cast-metal transformer enclosure shall comply with the requirements in 7.5.1. A transformer enclosure of other material shall have strength and rigidity, and otherwise be rated for the purpose.

7.5 Cast metal

7.5.1 A cast-metal enclosure shall be at least 1/8 inch (3.2 mm) thick at every point, more than 1/8 inch thick at reinforcing ribs and door edges, and not less than 1/4 inch (6.4 mm) thick at tapped holes for conduit.

Exception: Other than at plain or threaded conduit holes, die-cast metal may be:

- a) Not less than 3/32 inch (2.4 mm) thick for an area greater than 24 square inches (154.8 cm²) or having dimensions more than 6 inches (152 mm).*
- b) Not less than 1/16 inch (1.6 mm) thick for an area of 24 square inches or less and having no dimensions more than 6 inches. The area limitation may be obtained by the provision of reinforcing ribs subdividing a larger area.*
- c) Not less than 0.035 inch (0.89 mm) thick if the enclosure will not be used as a splice box and if the voltage rating of the complete device is such that the voltage between any two conductors is 250 volts or less, and is limited to direct current or single-phase alternating current.*
- d) Not less than 0.028 inch (0.71 mm) thick if the enclosure houses only low-voltage circuits.*

7.6 Sheet metal

7.6.1 Other than at points where a wiring system is to be connected, the thickness of a sheet-metal enclosure shall not be less than that specified in Tables 7.1 and 7.2.

Exception: A room thermostat shall be as specified in 7.9.3.

7.6.2 At points at which a wiring system is to be connected, uncoated steel shall not be less than 0.032 inch (0.81 mm) thick, zinc-coated steel shall not be less than 0.034 inch (0.86 mm) thick, and nonferrous metal shall not be less than 0.045 inch (1.14 mm) thick.

7.6.3 Tables 7.1 and 7.2 are based on a uniform deflection of the enclosure surface for a given load concentrated at the center of the surface regardless of metal thickness.

7.6.4 With reference to Tables 7.1 and 7.2, a supporting frame is a structure of angle or channel or a folded rigid section of sheet metal that is rigidly attached to and has essentially the same outside dimensions as the enclosure surface, and that has sufficient torsional rigidity to resist the bending moments that may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure that is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes:

- a) Single sheet with single formed flanges – formed edges,
- b) A single sheet that is corrugated or ribbed,
- c) An enclosure surface loosely attached to a frame, for example, with spring clips.

7.7 Polymeric

7.7.1 A polymeric enclosure or enclosure part shall have mechanical strength and durability and be formed so that operating parts will be protected against damage, and shall resist the abuses likely to be encountered during installation and intended use and service.

7.7.2 An enclosure or enclosure part shall protect persons against a risk of electric shock. The enclosure material shall not create or contribute to a risk of fire, electric shock, or injury to persons.

Table 7.1
Minimum thickness of sheet metal for enclosures – carbon steel or stainless steel

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness, inch (mm)	
Maximum width ^b , Inches (cm)	Maximum length ^c , Inches (cm)	Maximum width ^b , Inches (cm)	Maximum length, Inches (cm)		
4.0 (10.2)	Not limited	6.25 (15.9)	Not limited	0.020 ^d (0.51)	0.023 ^d (0.58)
4.75 (12.1)	5.75 (14.6)	6.75 (17.1)	8.25 (21.0)		
6.0 (15.2)	Not limited	9.5 (24.1)	Not limited	0.026 ^d (0.66)	0.029 ^d (0.74)
7.0 (17.8)	8.75 (22.2)	10.0 (25.4)	12.5 (31.8)		
8.0 (20.3)	Not limited	12.0 (30.5)	Not limited	0.032 (0.81)	0.034 (0.86)
9.0 (22.9)	11.5 (29.2)	13.0 (33.0)	16.0 (40.6)		
12.5 (31.8)	Not limited	19.5 (49.5)	Not limited	0.042 (1.07)	0.045 (1.14)
14.0 (35.6)	18.0 (45.7)	21.0 (53.3)	25.0 (63.5)		
18.0 (45.7)	Not limited	27.0 (68.6)	Not limited	0.053 (1.35)	0.056 (1.42)
20.0 (50.8)	25.0 (63.5)	29.0 (73.7)	36.0 (91.4)		
22.0 (55.9)	Not limited	33.0 (83.8)	Not limited	0.060 (1.52)	0.063 (1.60)
25.0 (63.5)	31.0 (78.7)	35.0 (88.9)	43.0 (109.2)		
25.0 (63.5)	Not limited	39.0 (99.1)	Not limited	0.067 (1.70)	0.070 (1.78)
29.0 (73.7)	36.0 (91.4)	41.0 (104.1)	51.0 (129.5)		
33.0 (83.8)	Not limited	51.0 (129.5)	Not limited	0.080 (2.03)	0.084 (2.13)
38.0 (96.5)	47.0 (119.4)	54.0 (137.2)	66.0 (167.6)		
42.0 (106.7)	Not limited	64.0 (162.6)	Not limited	0.093 (2.36)	0.097 (2.46)
47.0 (119.4)	59.0 (149.9)	68.0 (172.7)	84.0 (213.4)		
52.0 (132.1)	Not limited	80.0 (203.2)	Not limited	0.108 (2.74)	0.111 (2.82)
60.0 (152.4)	74.0 (188.0)	84.0 (213.4)	103.0 (261.6)		
63.0 (160.0)	Not limited	97.0 (246.4)	Not limited	0.123 (3.12)	0.126 (3.20)
73.0 (185.4)	90.0 (228.6)	103.0 (261.6)	127.0 (322.6)		

^a See 7.6.4.

^b The width is the smaller dimension of a rectangular sheet metal piece that is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.

^c Not limited applies only if the edge of the surface is flanged at least 1/2 inch (12.7 mm) and fastened to adjacent surfaces not normally removed in use.

^d Sheet steel for an enclosure intended for outdoor use – raintight or rainproof – shall not be less than 0.034 inch (0.86 mm) thick if zinc coated, and not less than 0.032 inch (0.81 mm) thick if uncoated.

Table 7.2
Minimum acceptable thickness of sheet metal for enclosures – aluminum, copper, or brass

Table 7.2 revised October 24, 1995

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness inch (mm)
Maximum width ^b , Inches (cm)	Maximum length ^c , Inches (cm)	Maximum width ^b , Inches (cm)	Maximum length, Inches (cm)	
3.0 (7.6)	Not limited	7.0 (17.8)	Not limited	0.023 ^d
3.5 (8.9)	4.0 (10.2)	8.5 (21.6)	9.5 (24.1)	(0.58)
4.0 (10.2)	Not limited	10.0 (25.4)	Not limited	0.029
5.0 (12.7)	6.0 (15.2)	10.5 (26.7)	13.5 (34.3)	(0.74)
6.0 (15.2)	Not limited	14.0 (35.6)	Not limited	0.036
6.5 (16.5)	8.0 (20.3)	15.0 (38.1)	18.0 (45.7)	(0.91)
8.0 (20.3)	Not limited	19.0 (48.3)	Not limited	0.045
9.5 (24.1)	11.5 (29.2)	21.0 (53.3)	25.0 (63.5)	(1.14)
12.0 (30.5)	Not limited	28.0 (71.1)	Not limited	0.058
14.0 (35.6)	16.0 (40.6)	30.0 (76.2)	37.0 (94.0)	(1.47)
18.0 (45.7)	Not limited	42.0 (106.7)	Not limited	0.075
20.0 (50.8)	25.0 (63.5)	45.0 (114.3)	55.0 (139.7)	(1.91)
25.0 (63.5)	Not limited	60.0 (152.4)	Not limited	0.095
29.0 (73.7)	36.0 (91.4)	64.0 (162.6)	78.0 (198.1)	(2.41)
37.0 (94.0)	Not limited	87.0 (221.0)	Not limited	0.122
42.0 (106.7)	53.0 (134.6)	93.0 (236.2)	114.0 (289.6)	(3.10)
52.0 (132.1)	Not limited	123.0 (312.4)	Not limited	0.153
60.0 (152.4)	74.0 (188.0)	130.0 (330.2)	160.0 (406.4)	(3.89)

^a See 7.6.4.

^b The width is the smaller dimension of a rectangular piece of sheet metal that is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.

^c Not limited applies only if the edge of the surface is flanged at least 1/2 inch (12.7 mm) and fastened to adjacent surfaces not normally removed in use.

^d Sheet copper, brass, or aluminum for an enclosure intended for outdoor use – raintight or rainproof – shall not be less than 0.029 inch (0.74 mm) thick.

7.7.3 Among the factors that are to be taken into consideration when investigating the acceptability of a polymeric enclosure are:

- a) Mechanical strength;
- b) Resistance to impact;
- c) Moisture absorption;

- d) Resistance to combustion and to ignition from electrical sources;
- e) Dielectric properties, insulation resistance, and resistance to arc tracking; and
- f) Resistance to distortion and creeping at temperatures to which the material may be subjected under conditions of normal or abnormal use.

7.7.4 A material shall not display a loss of the properties specified in 7.7.3 beyond the minimum acceptable level as a result of aging.

7.7.5 The tests for determining compliance of a polymeric enclosure used with equipment covered by this standard are described in Polymeric Materials Tests, Section 62.

Exception: The cover of a wall-mounted room thermostat need not comply with the requirements in Polymeric Materials Tests, Section 62, but will be subjected to an appropriate investigation.

7.7.6 The polymeric enclosure material shall be rated for the normal operating temperature encountered in service and have a temperature rating at least equal to the normal operating temperature as determined by the temperature test described in Temperature Test, Section 40.

7.7.7 If continuity of a grounding system relies on dimensional integrity of a nonmetallic material, the dimensional stability of the material shall be considered in addition to the factors mentioned in 7.7.3.

7.7.8 A part, such as a dial or nameplate, that is a part of an enclosure shall be metal or other material as specified for the enclosure in 7.5.1 – 7.7.6.

7.7.9 A nonmetallic part such as a reset knob, lever, or button that protrudes through a hole in the enclosure that is not larger than the area of a 7/8-inch (22.2-mm) diameter circle shall be made of a material classified as V-0, V-1, or V-2 in the Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94.

7.7.9 revised June 2, 1998

7.7.10 A nonmetallic part that protrudes through a hole larger than the area of a 7/8-inch (22.2-mm) diameter circle shall be made of a material that complies with the requirements in 7.7.1, 7.7.2, and 7.7.8. See 7.10.6.

7.7.11 A nonmetallic cover that gives access to bare live parts shall comply with the requirements in 7.3.8 and Snap-On Covers Test, Section 58 and there shall be no exposure of live parts.

7.7.12 A cover attached by screws shall comply with the requirements in 7.3.8 with the screws tightened, and with the screws loosened one full turn.

7.8 Windows

7.8.1 Glass covering an observation opening shall be reliably secured in place so that it cannot be readily displaced in service, and shall provide mechanical protection for the enclosed parts.

7.8.2 Glass for an opening not more than 4 inches (102 mm) in any dimension shall not be less than 1/16 inch (1.6 mm) thick, and glass for a larger opening, but not more than 144 square inches (929 cm²) in area and having no dimension greater than 12 inches (305 mm), shall not be less than 1/8 inch (3.2 mm) thick. Glass that covers a larger area shall not be less than 1/8 inch thick and shall conform to one of the following:

- a) The glass shall be of a nonshattering or tempered type that, when broken, shall conform to the performance specifications in the Safety Performance Specifications and Methods of Test for Safety Glazing Material Used in Buildings, ANSI Z97.1-1984; or
- b) Shall withstand a 2-1/2 foot-pound (2.41 J) impact from a 2-inch (50.8-mm) diameter, 1.18 pound (535 g) steel sphere without cracking or breaking to the extent that a piece is released or dropped from its intended position.

7.8.3 A transparent material other than glass employed as a covering over an opening in an enclosure shall be investigated to determine if it has adequate mechanical strength and is otherwise acceptable for the purpose.

7.9 Room thermostats

7.9.1 A room thermostat intended for assembly on a flush-mounted box shall be provided with a box of sheet steel not less than 0.053 inch (1.35 mm) thick – 0.056 inch (1.42 mm) if zinc coated; or with a cast-metal box not less than 1/8 inch (3.2 mm) thick.

Exception: A room thermostat need not be furnished with a box if means for mounting on a standard outlet box – minimum inside width 1-13/16 inches (56.0 mm), minimum inside length 2-27/32 inches (72.2 mm) is provided and if, when so mounted on the intended box and when the full displacements and tolerances permitted by the mounting means are considered, at least the minimum required spacings are provided.

7.9.2 Zinc-base die-cast metal shall not be used for a flush box.

7.9.3 A residential room-thermostat cover having no dimension greater than 6 inches (152 mm) and having no surface greater than 18 square inches (116.1 cm²) may be not less than 0.020 inch (0.51 mm) thick uncoated steel, 0.023 inch (0.58 mm) zinc-coated steel, 0.023 inch nonferrous metal, or 0.035 inch (0.89 mm) die-cast metal.

Exception No. 1: A 0.016-inch (0.41-mm) thick uncoated steel, 0.019-inch (0.48-mm) zinc-coated steel, 0.018-inch (0.46-mm) nonferrous metal, or 0.032-inch (0.81-mm) die-cast metal may be employed if there are no live parts exposed when the thermostat cover is removed.

Exception No. 2: The thickness of a cover that is decorative only is not specified; the mounting plate and mechanism shall comply with the enclosure requirements with the cover removed.

7.9.4 The enclosure of a room thermostat is to be formed so that its shape and means of support provide adequate mechanical strength.

7.10 Openings

7.10.1 An opening shall not be provided in an enclosure that houses a fuse or any portion of a circuit breaker other than the operating handle, unless the construction affords containment of electrical fault disturbances equivalent to that provided by an enclosure complying with the requirements in 7.3.5 – 7.3.7.

7.10.1 effective February 28, 1997

7.10.2 The following requirements apply to openings other than those provided in the enclosure of a room thermostat:

- a) An opening shall not be provided in a compartment or part of an enclosure that contains field-wiring splices in a line-voltage circuit.
- b) No openings shall be located in the mounting surface of an enclosure.

Exception: The following openings may be located in the mounting surface of an enclosure:

- 1) A mounting opening;*
 - 2) A maximum of four openings provided for the escape of air or paint during a painting process. The maximum dimension of such an opening shall not exceed 1/8 inch (3.2 mm); or*
 - 3) A maximum of four unused holes provided for mounting of internal components. The maximum dimension of such an opening shall not exceed 3/16 inch (4.8 mm).*
- c) If the bottom surface is not the mounting surface, an opening may be provided in the bottom surface of an enclosure if the opening does not permit materials to fall directly out from the interior of the unit. See Figure 7.2 for an example of a construction that may be used.
 - d) The shortest distance between an opening and the bottom of an enclosure or a wall-mounting surface shall be at least one-quarter of the enclosure height or depth, respectively, or 1 inch (25.4 mm), whichever is less.
 - e) There shall be no emission of flame or molten material, or manifestation of risk of fire, during normal or abnormal tests on the control, such as transformer burnout and burnout of a relay or solenoid with blocked armature.
 - f) Unless the construction of a device provided with forced ventilation is such that there is no direct path between live parts and the outlet opening, burnout tests in addition to those mentioned in (e) shall be conducted to determine that there is no emission of flame or molten material through that opening.
 - g) Air from an opening, either forced or otherwise, shall not be directed into a duct or into a concealed space in a building, against the mounting surface, and so that a disturbance would be propagated to other equipment.
 - h) No more than four holes for mounting an enclosure having a maximum dimension of 18 inches (457 mm); six holes for an enclosure with a maximum dimension of more than 18 inches, but less than 48 inches (1.2 m); eight holes for an enclosure with a maximum dimension of 48 inches or more. Four of the holes for mounting an enclosure with a maximum dimension of 12 inches (305 mm) may be keyhole slots having the configuration illustrated in Figure 7.3. The dimensions shown in Figure 7.3 may vary if the area is equivalent. Four of the holes for mounting a larger enclosure may be keyhole slots, the dimensions of which are not specified, and which shall be investigated with regard to the enclosure dimensions and configuration.

7.10.2 effective February 28, 1997

Figure 7.2
Bottom surface openings of enclosures


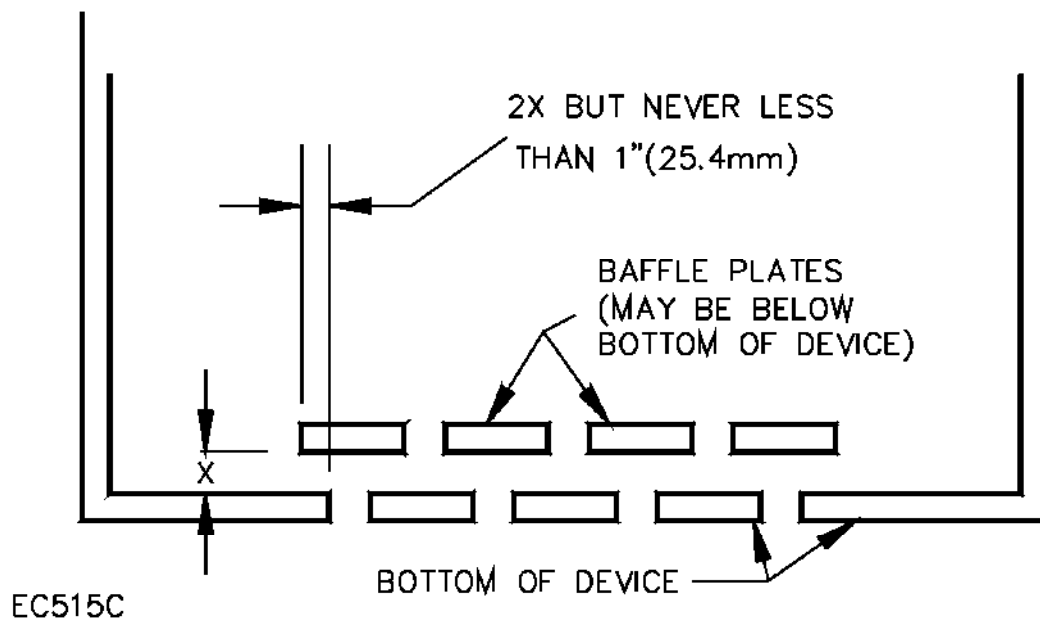


Figure 7.3
Keyhole slot

Figure 7.3 effective February 28, 1997

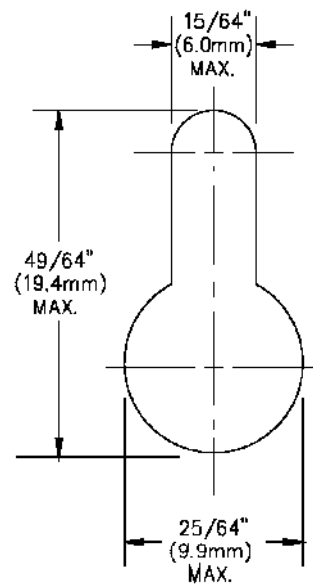

7.10.3 Deleted effective February 28, 1997

7.10.3 effective February 28, 1997

7.10.4 A room thermostat rated more than 300 volts, with the outer cover on or removed, shall comply with the requirements in 7.2.2.

7.10.4 effective February 28, 1997

7.10.5 An opening, such as a perforated hole, a louver, or an opening protected by wire screening, expanded metal, or a perforated cover, in the enclosure of a room thermostat the rating of which includes a value of 300 volts or less shall not permit passage of a 17/64-inch (6.7-mm) diameter rod.

Exception No. 1: If the distance between an uninsulated live part and the edge of an opening is 2-1/2 inches (63.5 mm) or more, the opening may permit passage of a 17/64-inch diameter rod but shall not permit passage of a 33/64-inch (13.1-mm) diameter rod.

Exception No. 2: If other means, such as an internal barrier or arrangement of parts provides equivalent protection, the maximum size of an individual opening in an enclosure is not specified.

7.10.5 effective February 28, 1997

7.10.6 The smaller dimension – width – of an opening in an enclosure around a dial, adjusting knob, lever, handle, pointer, or the like shall not be more than 1/8 inch (3.2 mm) for any setting or position of the dial, knob, or other members.

7.10.7 Deleted effective February 28, 1997

7.10.7 effective February 28, 1997

7.10.8 A plate or plug for an unused conduit opening or other hole in an enclosure shall have a thickness not less than 0.014 inch (0.36 mm) for steel or 0.019 inch (0.48 mm) for nonferrous metal for a hole having a 1/4-inch (6.4-mm) maximum dimension and 0.027-inch (0.69-mm) steel or 0.032-inch (0.81-mm) nonferrous metal for a hole having a 1-3/8-inch (34.9-mm) maximum dimension. A closure for a larger hole shall have a thickness equal to that required for the enclosure of the device or a standard knockout seal shall be used. Such a plate or plug shall be securely mounted.

7.11 Screens and expanded metal

7.11.1 The wires of a screen shall not be less than No. 16 AWG for screen openings 1/2 square inch (3.2 cm²) or less in area, and shall not be less than No. 12 AWG for larger screen openings.

7.11.2 Perforated sheet steel, and sheet steel employed for expanded metal mesh, shall not be less than 0.042 inch (106.7 mm) thick – 0.045 inch (114.3 mm) if zinc coated – for mesh openings or perforations 1/2 square inch (3.2 cm²) or less in area and shall not be less than 0.080 inch (203.2 mm) thick – 0.084 inch (213.3 mm) if zinc coated – for larger openings.

Exception: Expanded metal mesh that complies with the requirements in 7.11.3 may be used.

7.11.3 In a small device where the indentation of a guard or enclosure will not alter the clearance between uninsulated, movable, current-carrying parts and grounded metal, so as to adversely affect performance or reduce spacings below the minimum acceptable values specified in Table 33.1, 0.020-inch (0.51-mm) expanded metal mesh – 0.023-inch (0.58-mm) if zinc coated – may be employed, provided the exposed mesh on any one side or surface of the device so protected has an area of not more than 72 square inches (464.5 cm²) and has no dimension greater than 12 inches (305 mm) or the width of an opening so protected is not greater than 3-1/2 inches (88.9 mm).

7.12 Wiring openings

7.12.1 If threads for the connection of conduit are tapped all the way through a hole in an enclosure wall, or if an equivalent construction is used, there shall be no less than three threads in the metal, and the construction of the control shall be such that a conduit bushing can be attached as intended.

7.12.1 effective August 28, 1995

No Text on This Page

7.12.2 If threads for the connection of conduit are not tapped all the way through a hole in an enclosure wall, conduit hub, or the like, there shall not be less than 3-1/2 threads in the metal and there shall be a smooth, rounded inlet hole for the conductors that affords protection to the conductors equivalent to that provided by a standard conduit bushing and that has an internal diameter approximately the same as that of the corresponding trade size of rigid conduit.

7.12.3 In an enclosure threaded for support by rigid conduit at least five full threads shall be provided for engaging the conduit.

7.12.4 A conduit hub or nipple attached to the enclosure of a pressure switch or similar equipment by swaging, staking, or similar means shall withstand, without pulling apart, a direct pull of 200 pounds (890 N), a bending moment of 600 pound-inches (67.8 N·m), and a torque of 600 pound-inches, each applied in turn for 5 minutes.

7.12.5 For the pullout test, the equipment is to be supported by a rigid conduit in the intended manner and is to support a weight of 200 pounds (90.8 kg).

7.12.6 For the bending and torsion tests, the equipment is to be rigidly supported by means other than the conduit fittings.

7.12.7 In the bending test, the force is to be applied to the conduit at right angles to its axis, and the lever arm is to be measured from the wall of the enclosure in which the hub or stud is located to the point of application of the bending force.

7.12.8 In the torsion test, the force is to be applied to the conduit in a direction tending to tighten the connection, and the lever arm is to be measured from the center of the conduit.

7.12.9 With reference to 7.12.5 – 7.12.8, some distortion of the enclosure under test may result. The test may be discontinued when noticeable distortion occurs.

7.12.10 Clamps and fasteners for the attachment of conduit, electrical metallic tubing, armored cable, nonmetallic flexible tubing, nonmetallic-sheathed cable, service cable, and the like that are supplied as a part of an enclosure shall comply with the requirements in the Standard for Fittings for Cable and Conduit, UL 514B.

7.12.10 revised June 2, 1998

7.12.11 A knockout in a sheet-metal enclosure shall be reliably secured but shall be capable of being removed without undue deformation of the enclosure.

7.12.12 A knockout shall be provided with a flat surrounding surface adequate for proper seating of a conduit bushing, and shall be located so that installation of a bushing at any knockout likely to be used during installation will not result in a spacing between uninsulated live parts and the bushing less than that required by this standard.

7.12.13 For an enclosure not provided with conduit openings or knockouts, spacings not less than the minimum required in this standard shall be provided between uninsulated live parts and a conduit bushing installed at any location likely to be used during installation. Permanent marking on the enclosure, a template, or a full-scale drawing provided with the device may be used to limit such a location.

7.12.14 In measuring a spacing between an uninsulated live part and a bushing installed in the knockout referred to in 7.12.12 and 7.12.13, it is to be assumed that a bushing having the dimensions in Table 7.3 is in place, and that a single locknut is installed on the outside of the enclosure.

Table 7.3
Dimensions of bushings

Trade size of conduit, inches	Overall diameter,		Height,	
	inches	(mm)	inches	(mm)
1/2	1	(25.4)	3/8	(9.5)
3/4	1-15/64	(31.4)	27/64	(10.7)
1	1-19/32	(40.5)	33/64	(13.1)
1-1/4	1-15/16	(49.2)	9/16	(14.3)
1-1/2	2-13/64	(56.0)	19/32	(15.1)
2	2-45/64	(68.7)	5/8	(15.9)
2-1/2	3-7/32	(81.8)	3/4	(19.1)
3	3-7/8	(98.4)	13/16	(20.6)
3-1/2	4-7/16	(112.7)	15/16	(23.8)
4	4-31/32	(126.2)	1	(25.4)
4-1/2	5-35/64	(140.9)	1-1/16	(27.0)
5	6-7/32	(158.0)	1-3/16	(30.2)
6	7-7/32	(183.4)	1-1/4	(31.8)

7.12.15 No wire other than wires leading to a part mounted on a door or cover shall be brought out through the door or cover.

7.13 Raintight and rainproof enclosures

7.13.1 When subjected to the Rain Test, Section 56, an enclosure designated as:

- a) Raintight shall restrict rain from entering the enclosure.
- b) Rainproof shall restrict rain from interfering with the successful operation of the apparatus used within the enclosure.

7.13.2 A raintight or rainproof enclosure shall be marked as specified in 69.7.

7.13.3 A gasket employed to make an enclosure raintight or rainproof shall be tested as specified in Accelerated Aging Tests on Gaskets, Sealing Compounds, and Adhesives, Section 54.

7.13.4 A raintight or rainproof enclosure shall be provided with external means for mounting.

Exception: A rainproof enclosure may be provided with internal means for mounting if the mounting means is intended to restrict water from entering the enclosure.

7.13.5 An opening for conduit in a raintight enclosure, other than in the bottom of the enclosure shall be threaded.

7.13.6 An opening for conduit in a rainproof enclosure shall be threaded unless located wholly below the lowest terminal lug or other live part within the enclosure. There shall be provision for drainage of the enclosure if a knockout or unthreaded hole is provided other than in the bottom.

8 Mounting

8.1 Provision shall be made for mounting a device securely in position. Bolts, screws, or other parts used for mounting a device shall be independent of those used to secure components of the device to the frame, base, or panel.

8.2 A control switch, a lampholder, an attachment-plug receptacle, or a plug connector provided as a part of a device shall be mounted securely and shall be prevented from turning by means other than friction between surfaces.

8.3 A properly applied lock washer may be used as a means to restrict a control switch from turning.

9 Parts Containing Liquid Metal

9.1 A part of a control intended for use with cooking or other food-handling appliances that contains mercury and the parts of any control that contain sodium-potassium shall be constructed of metal that:

- a) Has a tensile yield strength at a temperature of 120 percent of the maximum normal use Fahrenheit temperature equal to at least four times the hoop stress or other stress on the part at that temperature.
- b) Is known not to be susceptible to corrosion-stress-cracking when exposed to the contained liquid metals and external agents, or is subjected to appropriate tests.

10 Adjustment Stop

10.1 A part of a control that is user operated and that limits the degree of rotation or length of movement of an adjustment – hereinafter referred to as the adjustment stop – shall be constructed so that it withstands the usage encountered in its intended operation as determined by the applicable tests in Strength of Adjustment Stop Test, Section 61.

10.2 If it is intended that the end-product incorporate the means to limit the movement of the adjustment stop as described in 10.1, the requirements are to be applied to the end-product and not to the control, however:

- a) If an extended handle or the like is intended to be added on the appliance, the adjustment stop for the control shall have the strength necessary to prevent both damage and a change in calibration during shipping and handling.
- b) If a control has no adjustment stop and is intended to be assembled into an appliance plug or other mechanism, the adjusting means shall be provided with a temporary seal to reduce the likelihood of damage or a change in calibration prior to final assembly.
- c) The adjustment stop is to be tested as specified in Strength of Adjustment Stop Test, Section 61, except that the torque or force applied to the adjusting means need not be greater than 1 pound-inch (0.1 N·m) or 1 pound (4.5 N).

11 Operating Mechanism

11.1 A temperature-indicating or -regulating device shall be assembled so that it will not be adversely affected by the vibration of normal operation.

11.2 Screws and nuts that attach operating parts to movable members shall be upset or otherwise locked to reduce the likelihood of loosening under the conditions of actual use.

11.3 An operating mechanism shall not subject manually operated switch parts to undue stress.

11.4 The position of an operating handle shall be marked if necessary as a guide for proper operation.

11.5 A control that is intended for factory installation on an appliance and that has or is intended to have a marked off position or an implied off position – see 11.7 – 11.9 – shall:

- a) Open all ungrounded conductors of the circuit when the adjusting means is in the off position; and
- b) Be restricted from functioning automatically when in the off position either by a positive mechanical means or as specified in 11.10.

Exception No. 1: If unintentional energization of the appliance in which the control is intended to be used will not result in a risk of fire or electric shock – for example, a range oven having no live parts exposed to the user – the control need not comply with this requirement.

Exception No. 2: For a control intended for use in conjunction with another control, the requirement can be met by the combination of the two controls.

Exception No. 3: If energization of the appliance in which the control is intended to be used will not result in a risk of electric shock during operation or cleaning, or the like, but may result in a risk of fire or injury to persons if unintentionally energized – for example, a hot plate – the control need only open a sufficient number of conductors to de-energize the circuit.

11.6 A capillary-type control if specified for use in the end-product – for example, certain temperature-regulating controls for commercial cooking appliances – is to comply with the requirements specified in 11.5 with the capillary tube normal and cut, in separate tests.

11.7 A thermostat or a thermostatically controlled switching device intended for direct control of indoor electric space-heating equipment that is to be permanently connected electrically shall disconnect all ungrounded conductors of the supply circuit when:

- a) The actuating member is placed in a marked off position, or
- b) The actuating member is placed in an unmarked off position that is implied by the fact that there is a marked on position.

11.8 A device that is marked with a phrase such as “no heat” or “cold” that conveys the same meaning as the word “off” shall also comply with the requirement in 11.7.

11.9 A single-pole thermostat marked “Lo – Normal – High” or having a temperature scale such as 40 – 80 or a numerical scale such as 1 – 5 (not including the numeral 0) is not considered to have an off position as defined in 11.7.

11.10 A thermostat or thermostatically controlled switching device intended for direct control of indoor, electric-space-heating equipment that is to be permanently connected electrically that has a marked off position, or an unmarked off position that is implied by the fact that there is a marked on position shall not function as a thermostat (shall not respond to temperature changes) while the actuating member is in the off position.

11.11 A thermostat that does not reclose (remains open) when cooled to a temperature of minus 35°C (minus 31°F) is acceptable with respect to the requirement in 11.10.

11.12 A combined manual switch and thermostat intended for direct control of indoor electric space-heating equipment that is to be permanently connected electrically shall disconnect all ungrounded conductors of the supply circuit regardless of temperature, and shall be constructed so that the circuit cannot be energized automatically after the device has been manually placed in the off position.

11.13 A device involving electronic control circuits shall be investigated under conditions of actual service to determine if it complies with all applicable requirements and is otherwise acceptable for its intended application.

11.14 A marked off position shall have an air-gap construction.

Exception: A solid-state device may be employed but shall be subjected to an appropriate investigation to determine equivalent protection.

11.15 A component, such as a resistor, capacitor, diode, and the like, shall not be connected across the contacts of a safety control or a protective or limiting device.

Exception: A component may be connected across the contacts if investigated and found to be acceptable in the end product.

11.16 A water-heater temperature-limiting control shall be a manually reset control.

Exception: A temperature-limiting control for a marine-type storage-tank water heater may be a single-operation device. See Single-Operation Devices, Section 81.

11.17 A water-heater temperature-limiting control shall have no operating part in common with a water-heater temperature-regulating control, but a common mounting bracket or a common enclosure may be employed for both controls.

11.18 A temperature-regulating thermostat or control for a household electric storage tank water heater shall be set before leaving the factory to a control position corresponding to a temperature no higher than 60°C (140°F). This setting may be approximate, for a marking on the control that reads "Low-Medium-High" or the equivalent.

12 Reset Mechanism – Limiting Control

12.1 A control shall not reset or be resettable manually or otherwise so that operation of the controlled appliance can be resumed until after a safe operating condition is restored. For example, pressure or temperature returned to a value at or below the control set point.

12.2 A control that is intended to be reset manually shall not reset automatically as a result of changes in environmental temperature at temperatures at or above minus 35°C (minus 31°F) for a regular limiting control or a marine-type storage-tank water heater temperature-limiting control, and above 0°C (32°F) for a non-marine storage-tank water heater temperature-limiting control.

Exception: This requirement does not apply if it is not required for the end-use product.

12.2 revised January 16, 2004

12.3 A manually reset device shall be trip-free; that is, the automatic tripping shall be independent of the manipulation or position of the reset button, handle, lever, or the like.

12.4 A manually reset device of a control may provide one or another of the following kinds of reset function:

a) For a control designated "Manually Reset 1" or "M1", the control shall automatically reset to the closed position after normal operating conditions have been restored, if the reset means is held in the reset position. The operating tolerances specified in Calibration-Verification Test, Section 44, shall not be exceeded if the reset means is held in the reset or on position.

b) For a control designated "Manually Reset 2" or "M2", the control shall not function as an automatically reset device if the reset means is held in the reset or on position.

12.5 The means for resetting a control with a manual reset shall be external to the control enclosure.

Exception: If the control enclosure complies with the requirements for protection as specified in Protection of Users and Service Personnel, Section 23, and Protection Against Injury to Persons, Section 24, the means for resetting need not be external.

12.6 A manually reset mechanism shall not subject the operating mechanism or means of support to stress.

13 Means for Calibration

13.1 The following controls shall comply with the requirements in 13.2 – 13.8:

- a) A water-heater control;
- b) A refrigeration pressure-limiting device;
- c) An appliance temperature-limiting control including some regulating controls if limiting-control features are specified in the end-product standard;
- d) A time-delay or thermal relay that responds to a limiting control;
- e) A range oven-door-lock control;
- f) A clean-temperature control for a self-cleaning range oven; and
- g) A hot tub/spa water temperature control.

13.2 A means provided for factory calibration shall be factory-secured to restrict unintentional shifting after calibration.

13.3 A means for calibration that is accessible or apparent shall be modified, guarded, or sealed by a means such as soldering to effectively restrict manipulation by hand or an ordinary tool subsequent to factory calibration.

13.4 With reference to 13.3, a calibration means that is not considered to be accessible or apparent is a means that does not show, is not exposed to manipulation by a conventional tool, or is not readily displaced. Complete concealment of a conventional tool-engaging means in a screw, such as a slot, recessed head, or the like, by the use of solder, brazing material, or cement rated for the purpose is adequate to restrict manipulation if the calibration means cannot be changed readily by gripping with a conventional tool and engagement or manipulation is restricted at all other locations.

No Text on This Page

13.5 Enamel and other polymeric materials used to secure or seal the means of calibration at the factory are rated only for exposure to temperatures of 121°C (250°F) or less, unless they have been subjected to thermal aging tests and have been found acceptable for use at higher temperatures.

13.6 An adjustable control shall comply with the requirements in 13.2 and 13.3 with respect to the maximum temperature, pressure, or similar setting.

13.7 A temperature or pressure adjustment means, including a trim screw or the equivalent, shall be provided with a stop to restrict manipulation beyond a setting, or concealed or sealed, and in either case, factory-secured as required by 13.2.

13.8 Performance tests such as the calibration-verification tests, are to be conducted on samples having the highest setting permitted by the adjustment means, including a trim screw or the equivalent.

14 Protection Against Corrosion

14.1 Iron and steel parts shall be protected against corrosion by enameling, galvanizing, sherardizing, plating, or other equivalent means.

Exception No. 1: Bearings, thermal elements, or the like need not be protected if such protection is impracticable.

Exception No. 2: Small minor parts of iron or steel such as washers, screws, bolts, and the like that do not carry current need not be protected if corrosion of such unprotected parts would not be likely to result in a risk of fire, electric shock, or injury to persons.

Exception No. 3: Parts made of stainless steel, properly polished or treated if necessary need not be protected.

14.2 The requirement in 14.1 applies to all enclosing cases whether of sheet steel or cast iron, and to all springs and other parts upon which proper mechanical operation may depend.

14.3 An enclosure designated either raintight or rainproof shall be protected against corrosion in accordance with the requirements in 14.4 – 14.18.

14.4 Metal shall be used in combinations that are galvanically compatible.

14.5 A hinge or other attachment shall be resistant to corrosion.

14.6 These requirements do not contemplate corrosion that might be caused by exposure to the earth or other corrosive agents.

14.7 The requirements specified in 14.8 – 14.18 do not apply to a part, such as a decorative grille, that is not a required part of an enclosure.

14.8 A nonmetallic enclosure is to be investigated on the basis of the effect of exposure to ultraviolet light and water.

14.9 A metallic enclosure shall be protected against corrosion as specified in 14.10 – 14.18. See 7.5.1 – 7.6.4 for the required enclosure thickness.

14.10 Copper, bronze, brass containing not less than 80 percent copper, or stainless steel may be used without additional protection against corrosion. Aluminum – sheet, extrusion, or casting – die-cast zinc, or other metal shall be of a grade or alloy having resistance to atmospheric corrosion, equivalent to that specified for sheet steel of the required thickness or shall be subjected to appropriate tests, or shall be additionally protected against corrosion.

14.11 An enclosure of cast iron or malleable iron at least 1/8 inch (3.2 mm) thick shall be protected against corrosion by a 0.00015-inch (0.0130-mm) thick coating of zinc, cadmium, or the equivalent on the outside surface and a visible coating of such metal on the inside surface, or one coat of an organic finish of the epoxy or alkyd-resin type or other outdoor paint on each surface.

14.12 Unless acceptability of the paint can be determined by consideration of its composition, corrosion tests are required.

14.13 An enclosure of sheet steel having a thickness less than 0.126 inch (3.20 mm) if zinc-coated or 0.123 inch (3.12 mm) thick if uncoated shall be protected against corrosion by one of the following means or by other metallic or nonmetallic coatings that have been found to give equivalent protection as described in 14.16.

a) Hot-dipped mill-galvanized sheet steel conforming with the coating Designation G90 in the Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process, ASTM A653/A653M-94, with not less than 40 percent of the zinc on any side, based on the minimum single-spot test requirement in this ASTM designation. The weight of zinc coating may be determined by any suitable method; however, in case of question, the weight of coating shall be established in accordance with the Test Method for Weight of Coating on Zinc-Coated (Galvanized) Iron or Steel Articles, ASTM A90-81(1991).

b) A zinc coating, other than that provided on hot-dipped mill-galvanized sheet steel, uniformly applied to an average thickness of not less than 0.00061 inch (0.0155 mm) on each surface with a minimum thickness of 0.00054 inch (0.0137 mm). The thickness of the coating shall be established by the Metallic Coating Thickness Test, Section 55. An annealed coating shall also comply with 14.18.

c) A zinc coating conforming with 14.14 (a) or (b) with one coat of an organic finish of the epoxy or alkyd-resin type or other outdoor paint applied after forming on each surface. The acceptability of the paint is to be determined by consideration of its composition or by corrosion tests.

d) A cadmium coating not less than 0.001 inch (0.03 mm) thick on both surfaces. The thickness of coating shall be established in accordance with the Metallic Coating Thickness Test, Section 55.

e) A cadmium coating not less than 0.00075 inch (0.0191 mm) thick on both surfaces with one coat of outdoor paint on both surfaces, or not less than 0.00051 inch (0.013 mm) thick on both surfaces with two coats of outdoor paint on both surfaces. The thickness of the cadmium coating shall be established in accordance with the Metallic Coating Thickness Test, Section 55, and the paint shall be as specified in (c).

14.13 revised October 24, 1995

14.14 An enclosure of sheet steel 0.126 inch (3.20 mm) thick if zinc-coated or 0.123 inch (3.12 mm) thick if uncoated or heavier shall be protected against corrosion by one of the following means or by other metallic or nonmetallic coatings that have been shown to give equivalent protection as described in 14.16.

a) Hot-dipped mill-galvanized sheet steel conforming with the coating Designation G60 or A60 in the Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process, ASTM A653/A653M-94, with not less than 40 percent of the zinc on any side, based on the minimum single-spot test requirement in this ASTM designation. The weight of zinc coating may be determined by any suitable method; however, in case of question, the weight of coating shall be established in accordance with the Test Method for Weight of Coating on Zinc-Coated (Galvanized) Iron or Steel Articles, ASTM A90-81(1991).

b) A zinc coating, other than that provided on hot-dipped mill-galvanized sheet steel, uniformly applied to an average thickness of not less than 0.00041 inch (0.0104 mm) on each surface with a minimum thickness of 0.00034 inch (0.0076 mm). The thickness of the coating shall be established by the Metallic Coating Thickness Test, Section 55.

c) Two coats of an organic finish of the epoxy or alkyd-resin or other outdoor paint on each surface. The acceptability of the paint is to be determined by consideration of its composition or by corrosion tests.

d) Any one of the means specified in 14.13.

14.14 revised October 24, 1995

14.15 The requirements specified in 14.14 also apply to sheet steel 0.056 inch (1.42 mm) thick if zinc-coated or 0.053 inch (1.35 mm) thick if uncoated or heavier for an enclosure to be mounted within and protected from direct exposure to weather by the enclosure of other equipment, such as an air conditioner. Such an enclosure is not to be marked rainproof or raintight.

14.16 With reference to 14.13 – 14.15, other finishes, including paints, metallic finishes and combinations of the two may be accepted when comparative tests with galvanized sheet steel – without annealing, wiping or other surface treatment – conforming with 14.13(a) or 14.14(a), as applicable, indicate they provide equivalent protection. Among the factors that are to be taken into consideration when judging the acceptability of such coating systems are exposure to salt spray, moist carbon dioxide-sulfur dioxide-air mixtures, moist hydrogen sulfide-air mixtures, and ultraviolet light and water.

14.17 Test specimens of a finish as described in 14.14 or 14.16, 14.13(c), or 14.14(c), if the paint is tested, are to be consistent with the finish that is to be used in production with respect to the base metal, cleaning or pretreatment method, application method, number of coats, curing method, thickness, and the like.

14.18 A hot-dipped mill-galvanized A60 (alloyed) coating or an annealed zinc coating that is bent or similarly formed after annealing and that is not otherwise required to be painted shall be painted in the bent or formed area if the bending or forming process damages the zinc coating, except that such areas on the inside surface of an enclosure that water does not enter during the Rain Test, Section 56, need not be painted. The zinc coating is considered to be damaged if flaking or cracking of the zinc coating at the outside radius of the bent or formed section is visible at 25 power magnification. Simple sheared or cut edges and punched holes are not considered to be formed.

15 Insulating Material

15.1 A base for the support of a live part shall be of strong, noncombustible, moisture-resistant, insulating material.

15.2 A material other than slate, porcelain, phenolic or cold-molded composition, or one that is rated for the support of live parts shall be investigated under conditions of intended service to determine if it has the necessary electrical and mechanical properties and is otherwise rated for the application.

15.3 A base shall be constructed so that, considering the material used, it will withstand the most severe condition likely to be met in service.

15.4 Insulating material, including a barrier between parts of opposite polarity and material that may be subjected to the influence of an arc formed by opening a switch, shall be rated for the application.

15.5 Vulcanized fiber may be used for an insulating bushing, a washer, a separator, or a barrier, but not for the sole support of an uninsulated live part of other than a low-voltage circuit.

16 Supply Connections

16.1 General

16.1.1 Connections to wiring terminals of equipment that is to be permanently connected electrically and supply connections are connections that are made in the field when the equipment is installed.

16.1.2 Wires within an enclosure, compartment, raceway, or the like shall be routed or protected so that damage to conductor insulation cannot result from contact with a rough, sharp, or moving part.

16.2 Equipment permanently connected electrically

16.2.1 General

16.2.1.1 Wiring terminals or leads shall be provided and shall be rated for the connection of conductors having an ampacity not less than the largest of the following ratings that are applicable:

- a) One hundred twenty-five percent of the ampere rating of electric heating equipment for pools, hot tubs/spas, and space-heating equipment;
- b) One hundred twenty-five percent of the full-load motor-current rating in accordance with 67.4 and 67.5. See Table 45.2 or 45.3 for the ampere rating corresponding to the horsepower rating;
- c) For a combination load, 125 percent of the full-load motor current of the largest motor, plus 125 percent of the ampere rating of an electric space-heating equipment load that is to be permanently connected electrically, plus 125 percent of the continuous duty load, plus 100 percent of the sum of the current ratings of all other loads;
- d) For direct-current-motors intended to be operated from a rectified single-phase power supply unless marked in accordance with 70.10;
 - 1) One hundred ninety percent if a half-wave rectifier is used, or
 - 2) One hundred fifty percent if a full-wave rectifier is used; or